

SPECIFICATION

FOOTINGS
 -TYPE 2' FOOTINGS TO AS 1684.2
 350mm DIA. x 150mm DEEP PRECAST CONCRETE SOLE PLATES

MIN. SOLE PLATE FOUNDING DEPTHS:
 IN ACCORDANCE WITH AS 2870

SITE CLASSIFICATION

MIN. DEPTH
A, S, M
M-D
H

NOTE: SOLE PLATES MUST ALSO BE FOUND ON A MIN. OF 100mm INTO NATURAL SOIL WITH A MIN. BEARING CAPACITY OF 100 kPa. A DEEPER FOUNDING DEPTH MAY BE REQUIRED TO ACHIEVE THIS

STUMPS
 -100x100 MIN. TIMBER STUMPS OF A DURABILITY CLASS 1 OR 2 OR H5 TREATED WITH A MIN. STRESS GRADE OF F4

BEARERS
 ROOF LOAD WIDTH- MAX. 4665mm
 FLOOR LOAD WIDTH- 1725mm INTERNALLY
 - 1825mm MAX. ON EXT. WALLS

-2/140x42 LVL 15 (F17) BEARERS WITH A MAX. CONTINUOUS SPAN OF 2,900mm

MINIMUM BEARER CLEARANCE TO GROUND LEVEL:

TERMITE INSPECTION NOT REQUIRED: 150mm
 REQUIRED: 400mm

NOTE: ON SLOPING SITES, 400mm WHEN REQUIRED MAY BE REDUCED TO 150mm WITHIN 2m OF EXTERNAL WALLS

FLOOR JOISTS
 -90x45 MGPI0 FLOOR JOISTS AT MAX. 450 CENTRES WITH A MAX. CONTINUOUS SPAN OF 1800mm
 MAX. SINGLE SPAN OF 1300mm or

90x45 F5 FLOOR JOISTS AT MAX. 450 CENTRES WITH A MAX. CONTINUOUS SPAN OF 1600mm

WATERPROOFING & WATER RESISTANCE

ALL WET AREA FLOORINGS:

- ENSURE VINYL FLOORING IS DEEMED TO BE WATERPROOF & THAT ALL JOINS ARE SEALED
- UPTURN VINYL MIN. 25mm AT WALL/FLOOR JUNCTIONS TO CREATE WATERPROOF WATER STOP. SKIRTING BOARDS & ARCHITRAVES PLACED OVER UPTURN & SEALED TO VINYL WITH WATERPROOF ACRYLIC OR SILICONE SEALANT (REFER TO DETAIL)
- SKIRTING BOARDS & ARCHITRAVES TO WET AREAS TO BE SOLID TIMBER (IE. PINE OR HARDWOOD, NOT MDE)

SHOWER CUBICLE:

- 42x42x2mm ALLUM. WATERSTOP ANGLE OR VINYL FLOORING STOP WITH MIN. HORIZONTAL DIMENSION OF 40mm EITHER SIDE, SEALED TO WALL AT ALL WALL JUNCTIONS (CORNERS) EXTENDING A MIN. OF 1800mm FROM SHOWER BASE
- THERMOSET LAMINATE WALL PANELS MIN. OF 1800mm HIGH FROM SHOWER BASE

ABOVE BASINS, TROUGHES & SINKS (KITCHEN BENCH)

- 150mm HIGH WALL TILES MIN. ABOVE VESSELS WITH WATERPROOF ACRYLIC OR SILICONE SEALANT TO JUNCTIONS

ELECTRICAL NOTES

- LIGHT SWITCHES TO BE AT 1000mm ABOVE FLOOR LEVEL
- HEIGHTS OF POWER POINTS MEASURED FROM FLOOR LEVEL UNLESS OTHERWISE NOTED
- UNLESS DIMENSIONED POWER POINTS TO BE LOCATED TO THE NEAREST STUD
- POWER POINTS FOR APPLIANCES & SPLIT SYSTEM AIR-CONDITIONING TO SUIT MANUFACTURERS REQ.
- PROVIDE PHONE CABLING WITH CONDUIT & DRAW STRING PLUS TV. ANTENNA CABLING THROUGH BARGE END.

ENERGY EFFICIENCY- LIGHTING

- ARTIFICIAL LIGHTING MUST NOT EXCEED: CLASS 1 BUILDINGS- 5 W/m² VERANDA/PORCH- 4W/m² PERIMETER LIGHTING- MIN. 40 LUMENS/W IN ACCORDANCE WITH THE B.C.A PART 3.12
- INTERNAL LIGHTING MUST NOT EXCEED: 960 WATTS TOTAL
- PERIMETER LIGHTING COMPLIANT WITH: 8 WATT CFL GLOBE= 50 LUMENS/W 11 WATT CFL GLOBE= 75 LUMENS/W

FLOORING
 19mm THICK "YELLOW TONGUE" PARTICLEBOARD FLOORING.

TIMBER DURABILITY
 CLASS 1 OR 2 TIMBERS ARE SUITABLE FOR IN GROUND USE. ALTERNATIVELY, H5 TREATED TIMBER CAN BE USED

CLASS 1

SPF	DPP	HEIGHT	SPF	DPP	HEIGHT
☀	☀	200 F.F.L.	☀	☀	1200 F.F.L.
☀	☀	350 F.F.L.	☀	☀	1275 F.F.L.
☀	☀	750 F.F.L.	☀	☀	1350 F.F.L.
☀	☀	970 F.F.L.	☀	☀	1400 F.F.L.
☀	☀	1000 F.F.L.	☀	☀	2000 F.F.L.
☀	☀	1000 F.F.L.	☀	☀	IN ROOF

CLASS 2

SPF	DPP	HEIGHT	SPF	DPP	HEIGHT
☀	☀	200 F.F.L.	☀	☀	1200 F.F.L.
☀	☀	350 F.F.L.	☀	☀	1275 F.F.L.
☀	☀	750 F.F.L.	☀	☀	1350 F.F.L.
☀	☀	970 F.F.L.	☀	☀	1400 F.F.L.
☀	☀	1000 F.F.L.	☀	☀	2000 F.F.L.
☀	☀	1000 F.F.L.	☀	☀	IN ROOF

WALL FRAMES

COMMON STUDS: 90x25 F5 AT 600 CTS.
 TOP/BOTTOM FLATES: 45x90 F5
 NOGGINGS: 90x25 AT 1275 CTS.
 JAMB STUDS: 90x25 F5
 OPENING 0 - 900: 2/90x25 F5
 OPENING 900 - 2600: 3/90x25 F5
 OPENING 2600 - 4300: 3/90x25 F5

LINTELS

OPENINGS UP TO 1100: 90 x 45 F5
 OPENINGS UP TO 1500: 90 x 45 LVL 15
 OPENINGS UP TO 1800: 140 x 45 F7
 OPENINGS UP TO 2200: 140 x 45 LVL 15
 OPENINGS UP TO 2400: 190 x 45 F7
 OPENINGS UP TO 2600: 190 x 45 MGPI0
 OPENINGS UP TO 3000: 240 x 45 F7

*ALL STRUCTURAL TIMBER SIZES, FIXINGS & TIE-DOWNS ARE TO BE IN ACCORDANCE WITH AS 1684.2 2010

ELECTRICAL LEGEND

- - CEILING LIGHT OUTLET (240v)
- ▼ - PHONE POINT AT 200/1000
- - LED DOWNLIGHT
- ⊙ - SMOKE DETECTOR (DIRECT WIRED)
- ⊕ - EXHAUST FAN (SELF SEALING)
- ⊕ - INTERNAL SWITCH BOARD
- ⊕ - TV. POINT AT 200

TERMITE AREAS

THE PLACEMENT OF A CHEMICAL BARRIER OR SHEET METAL "ANT CAPS" TO THE TOPS OF TIMBER STUMPS IN ACCORDANCE WITH PART 3.1.3 OF THE B.C.A & AS 3660.1 IS SUFFICIENT WHEN PROTECTION AGAINST TERMITE ATTACK IS REQUIRED

NOTE: A MIN. OF 400mm CLEARANCE IS REQUIRED TO THE UNDERSIDE OF BEARERS ON SITES REQUIRING TERMITE INSPECTION. THIS CAN BE REDUCED TO 150mm ON SLOPING SITES WITHIN 2m OF EXTERNAL WALLS.

BUSHFIRE AREAS


DESIGN & SPECIFICATION DOES NOT CONSIDER SITES SUBJECT TO BUSHFIRE ATTACK. SITES DEEMED TO HAVE A BAL OF 12.5 OR MORE HAVE ADDITIONAL CONSTRUCTION REQUIREMENTS IN ACCORDANCE WITH PART 3.7.4 OF THE B.C.A & AS 3959

INTERNAL ELEVATIONS SPECIFICATION


WATER PIPE LOCATIONS			FITTING LOCATIONS		
No.	ITEM	ABOVE FFL	No.	ITEM	HEIGHT ABOVE FFL
1	TOILET	250	6	SINK	650
2	BIDET	250	7	DW	500
3	BATH	600	8	TROUGH	1085
4	SHOWER	1000/1800	9	WM	600/1275
5	BASIN	600	10	FR WASTE	-

FRAME OFFSETS: SHOWER ROSE= 430 CL, SHOWER TAPS= 250 CL, SOAP HOLDER= 550 CL


NOTES:
 - DIMENSIONS TAKEN FROM FRAME
 - SPLASHBACK TILES: 200x200
 - WET AREA SKIRTING BOARDS: SOLID TIMBER 67mm
 - POWERPOINT LOCATION

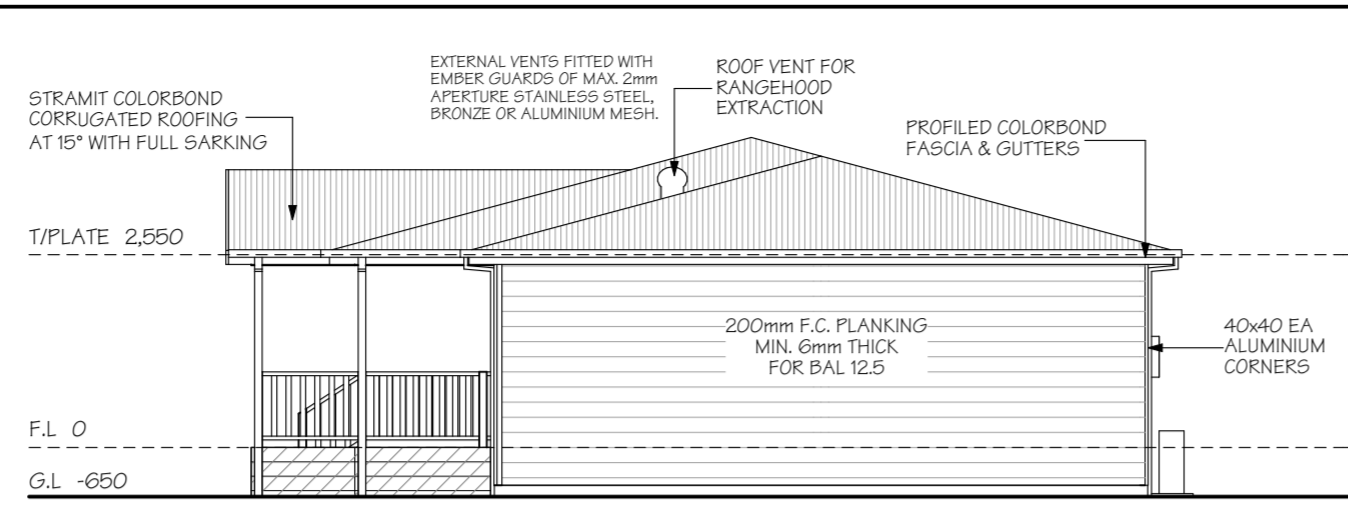


Elevation A

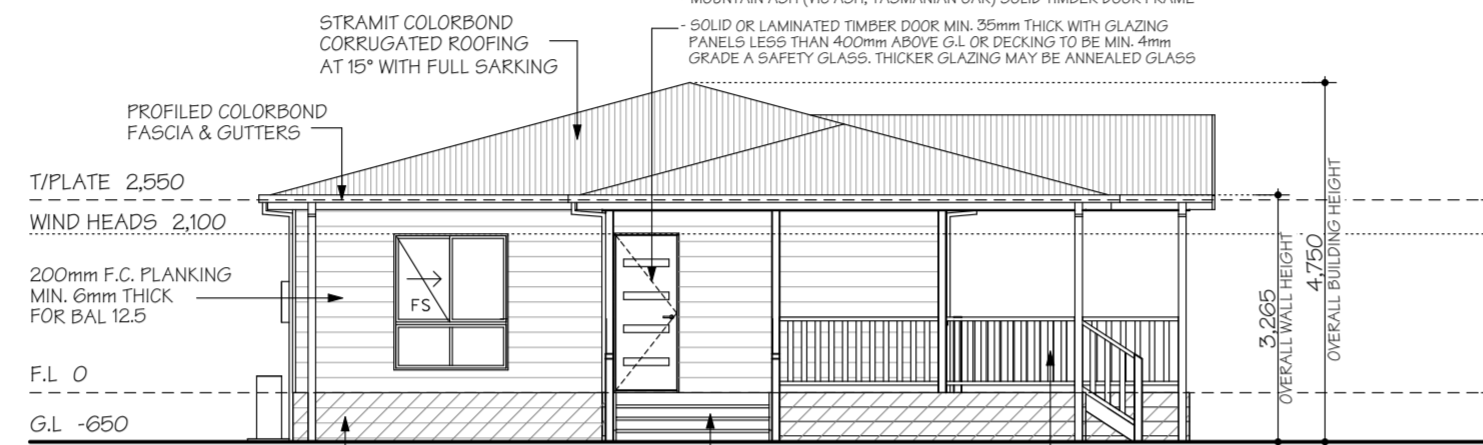


Elevation C

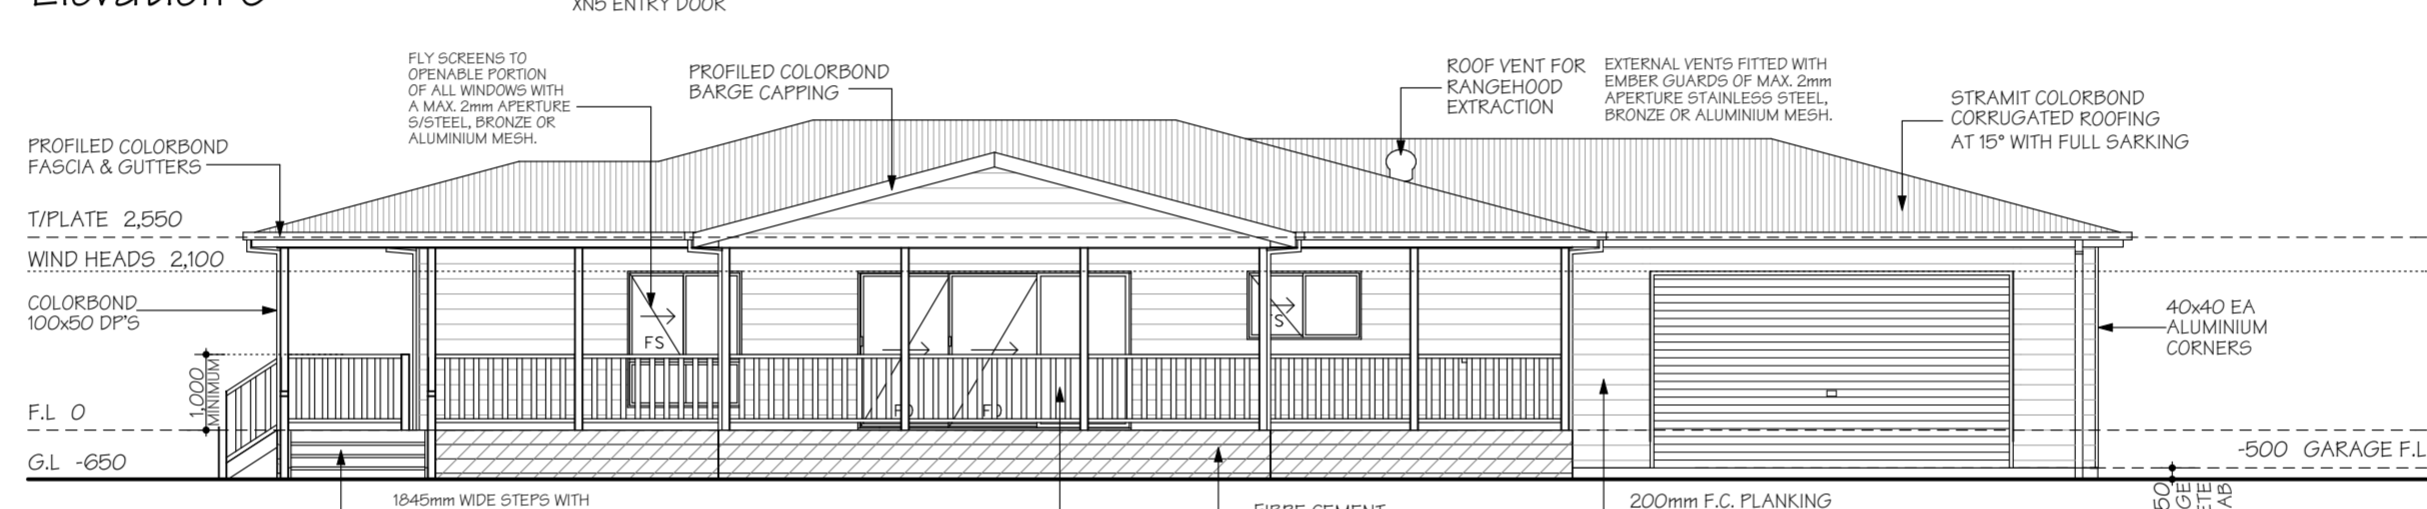

Elevation B

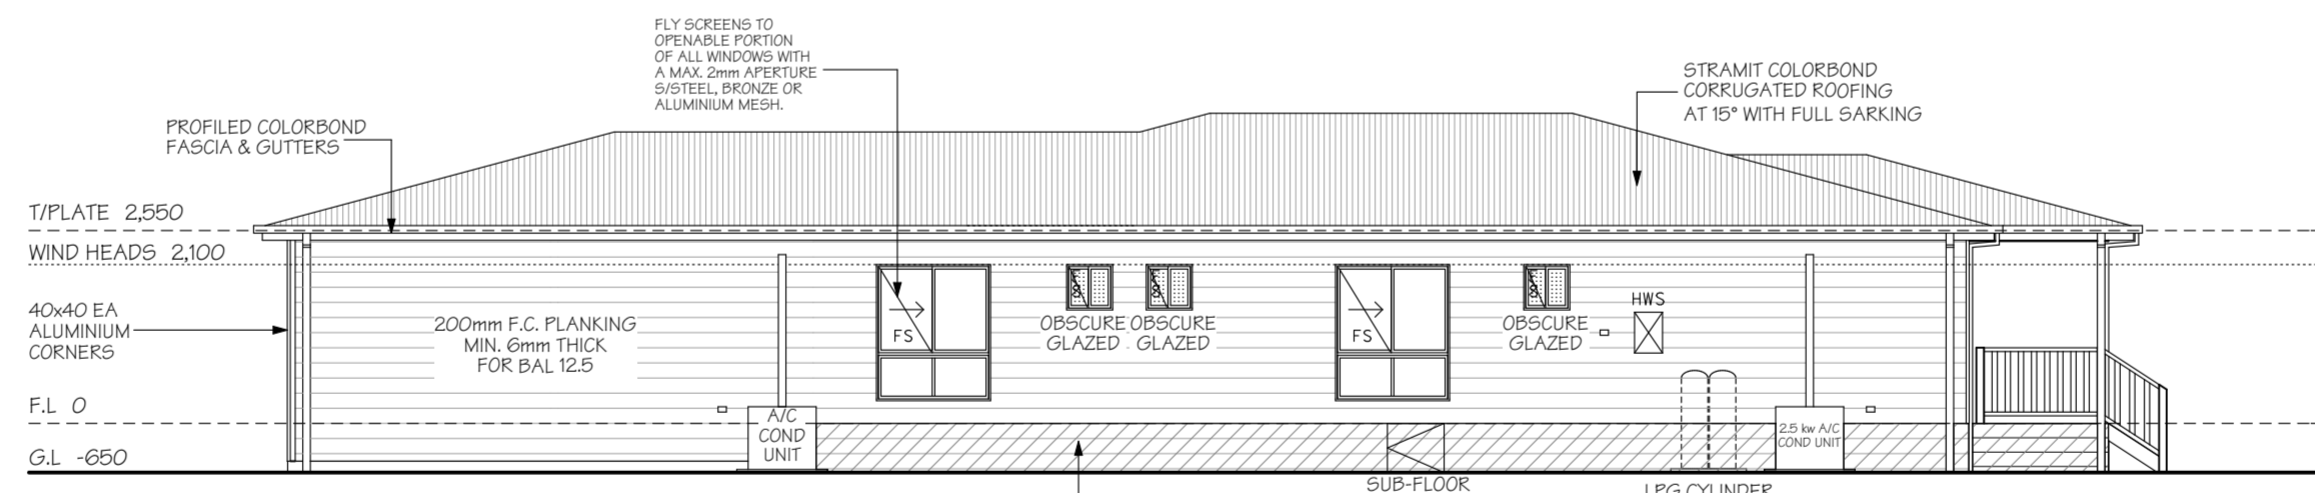

Elevation D

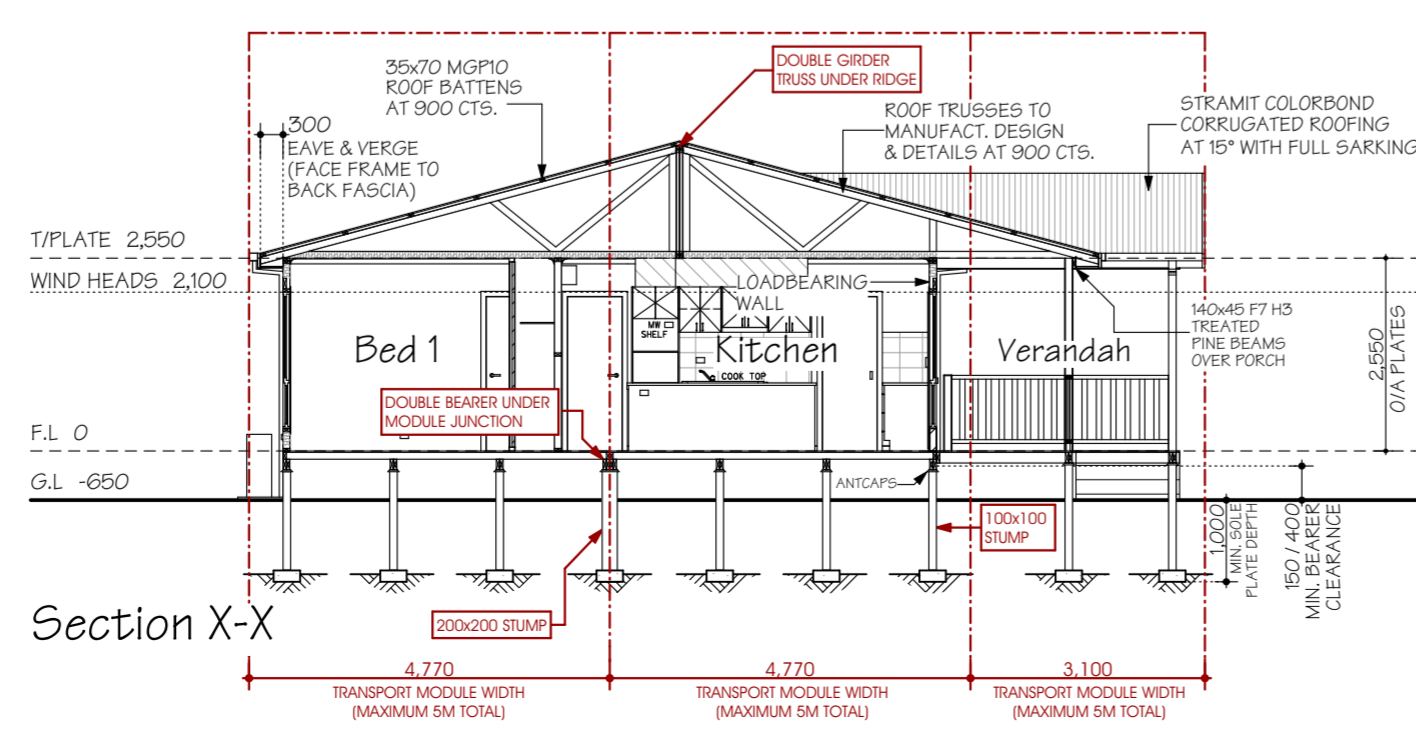

Section X-X

ENERGY EFFICIENCY

CLASS 1 BUILDINGS IN CLIMATE ZONE 6 ARE REQUIRED TO ACHIEVE A MIN. 6 STAR ENERGY RATING IN ACCORDANCE WITH PART 3.12 OF THE B.C.A. THIS IS ACHIEVED USING THE (DEEMED TO SATISFY PROVISIONS) OF PART 3.12 OF THE B.C.A. REFER TO ATTACHED REPORT FOR EXPLANATORY INFORMATION & OVERALL R-VALUES OF ROOF, WALL & FLOOR SYSTEMS

INSULATION VALUES

- ROOF: REFER TO 6 STAR ENERGY RATING REPORT
- WALLS: REFER TO 6 STAR ENERGY RATING REPORT
- FLOOR: REFER TO 6 STAR ENERGY RATING REPORT

* NOTE: REFLECTIVE FOIL INSULATION ASSUMES A SINGLE FOIL SIDED TYPE & POLY WEAVE BACKED WITH AN AVERAGE EMITANCE VALUE OF 0.05 OUTER & 0.05 INNER. THE REFLECTIVE SIDE MUST FACE DOWNWARD (ROOF) OR INWARD (WALLS) AND BE PLACED DIRECTLY UNDER THE ROOF & WALL CLADDING TO BE EFFECTIVE

EXTERNAL GLAZING

- EXTERNAL GLAZING IS SUBJECT TO BUILDING ORIENTATION. REFER TO ATTACHED GLAZING CALCULATION FOR SPECIFIC BUILDING ORIENTATION

BUILDING SEALING

- A SEAL TO RESTRICT AIR INFILTRATION MUST BE FITTED TO EACH EDGE OF AN EXTERNAL SLIDING DOOR, WINDOWS AND OPENINGS
- DRAFT PROTECTORS ARE REQUIRED TO BE FITTED TO THE BOTTOM EDGE OF EXTERNAL SWING DOORS AND SEALS TO THE HEAD AND SIDES
- SEALS MAY BE FOAM, RUBBER, FIBROUS OR THE LIKE
- EXHAUST FANS MUST BE FITTED WITH A SELF SEALING DEVICE SUCH AS A SELF-CLOSING DAMPER OR FILTER (RANGEHOOD)
- GAPS AND CRACKS AROUND ROOFS, EXTERNAL FLOORS, WALL/FLOOR/ROOF JUNCTIONS AND AROUND WINDOW AND DOOR FRAMES MUST BE MINIMISED THROUGH GOOD CONSTRUCTION PRACTICE. AND WITH THE PLACING OF CLOSE FITTING INTERNAL LINING AT JUNCTIONS, CAULKING, SKIRTING, ARCHITRAVES AND CORNICES.

SERVICES

- SERVICES PIPING AND DUCTWORK MUST COMPLY WITH THE MIN. INSULATION REQUIREMENTS OF PART 3.12.5 OF THE B.C.A.

GENERAL NOTES

- ENERGY EFFICIENCY (WALL, FLOOR, ROOF INSULATION & GLAZING) IN ACCORDANCE WITH PART 3.12 OF THE B.C.A. REFER TO ENERGY EFFICIENCY NOTES & GLAZING CALCULATIONS FOR DETAILS.
- WET AREAS IN ACCORDANCE WITH PART 3.8.1 OF THE B.C.A FOR WATERPROOFING & WATER RESISTANCE.
- STEPS: TREAD- 250mm MIN, RISER- 190mm MAX.
- BALUSTRADE : - AT STEPS- Ø66mm (MIN) HIGH - AT LANDING- 1000mm (MIN) HIGH
- WHERE REQUIRED, HORIZONTAL & VERT. GAPS IN BALUSTRADES MUST BE LESS THAN 125mm IN ACCORDANCE WITH B.C.A PART 3.9.2
- WRITTEN DIMENSIONS WILL TAKE PRECEDENCE OVER SCALE.
- UNLESS OTHERWISE INDICATED ALL WALL DIMENSIONS ARE: - EXTERNAL 90mm STUD - INTERNAL 90mm STUD
- WC / BATHROOM DOOR TO BE REMOVABLE WHERE REQUIRED AND FITTED WITH LIFT OFF HINGES IN ACCORDANCE WITH B.C.A PART 3.8.3.3
- ALL GLAZING TO COMPLY WITH PART 3.6 OF THE B.C.A & AS 1288
- MECHANICAL VENTILATION TO OUTSIDE AIR PROVIDED WHERE REQUIRED AND IN ACCORDANCE WITH B.C.A. P.2.4.5 / 3.8.5
- ROOF TRUSSES (WHERE USED) TO HAVE A MAXIMUM SPACING OF 900mm
- WINDOW GLAZING CODES: - (OB5) OBSCURE GLASS - (TL5) TRANSLUCENT GLASS - (DG) DOUBLE GLAZED
- ROOF ACCESS (WHERE APPLICABLE)
- SMOKE DETECTOR (DIRECT WIRED)
- DP - DOWNPIPE (STORMWATER CONNECTED)
- DP - DOWNPIPE (WATER TANK CONNECTED)

BAL 12.5
 CONSTRUCTION IN ACCORDANCE WITH AS 3959-2009 FOR A BAL OF 12.5

Callen Bray
 Building Design & Drafting
 Residential - Commercial - Industrial
 ABN: 38 040 205 161
 Phone: 0419 441 186
 Email: Callen_Bray@hotmail.com
 Registered Building Practitioner: DP-AD 36967

I/WE
 ACKNOWLEDGE THAT THESE PLANS ARE A TRUE AND ACCURATE REFLECTION OF OUR REQUIREMENTS AND AGREE THAT THESE PLANS ARE THE PLANS REFERRED TO IN THE MAJOR DOMESTIC BUILDING CONTRACT BETWEEN "BETNALE PTY LTD" (TRADING AS SUPERIOR GRANNY FLATS) AND MYSELF/OURSELVES AND AUTHORISE THEIR USE FOR NEXT STAGE PURPOSES. I/WE AM/ARE FULLY AWARE, IF ANY FURTHER CHANGES ARE TO BE MADE ON THESE PLANS WILL INCUR A VARIATION FEE.

SIGNED: DATE:
 SIGNED: DATE:

Proposed DPU,
 At: Lot 3 No. 14 Lower Somerville Road
 Somerville VIC 3912

8,64m x 22.23m
 2 Bedroom
 + Study

Sheet No: 3
 Issue: 16/11/22
 Rev: 1

For: Betnale Pty. Ltd.

Building Fabric R-Values

Roof Construction

- Climate Zone G: Upward Heat Flow
- Unventilated Roof Space
- 0.90 Solar Absorptance (Dark Grey)
- Min R-Value to be achieved R- 5.1

1. Outdoor Air Film (7 m/s)	R- 0.04
2. Metal Roof Cladding	R- 0.00
3. Poly Backed Ref. Foil Ins. (Ref. side down)	R- 0.00
4. Reflective Roof Airspace (as per B.C.A 3.12.1.2)	R- 0.55
5. Ceiling Insulation Batts (210mm)	R- 5.00
6. Plasterboard Ceiling	R- 0.06
7. Inside Air Film (Still Air)	R- 0.11
Total	R- 5.8

Wall Construction







- Climate Zone G
- Min R-Value to be achieved R- 2.8

1. Outdoor Air Film (7 m/s)	R- 0.04
2. F.C. Plank Cladding	R- 0.09
3. Wall Insulation Batts (90mm)	R- 2.50
4. Plasterboard (10mm)	R- 0.06
5. Inside Air Film (Still Air)	R- 0.12
Total	R- 2.8

Floor Construction

- Climate Zone G: Downward Heat Flow
- Enclosed Sub-Floor
- Min R-Value to be achieved R- 2.25

1. "Sancell Breeze" Reflective Foil Insulation (4mm)	R- 0.10
2. Sealed Reflective Airspace (90mm) (As per Sancell Products Specs.)	R- 2.80
Total	R- 2.9

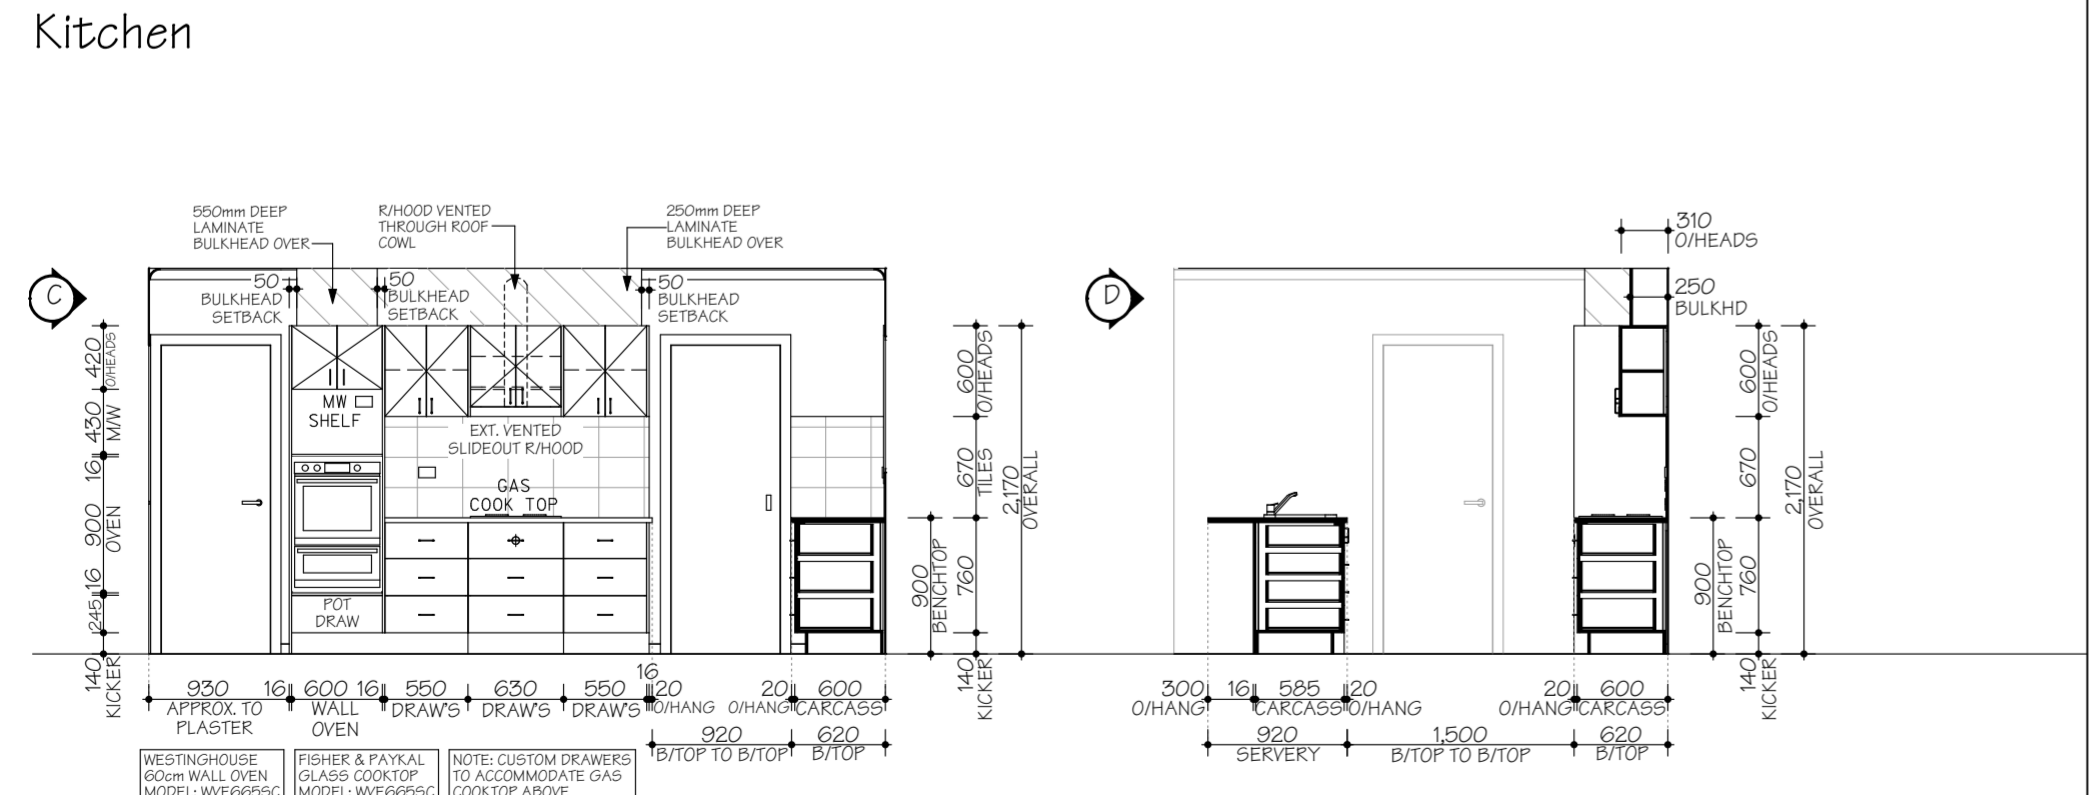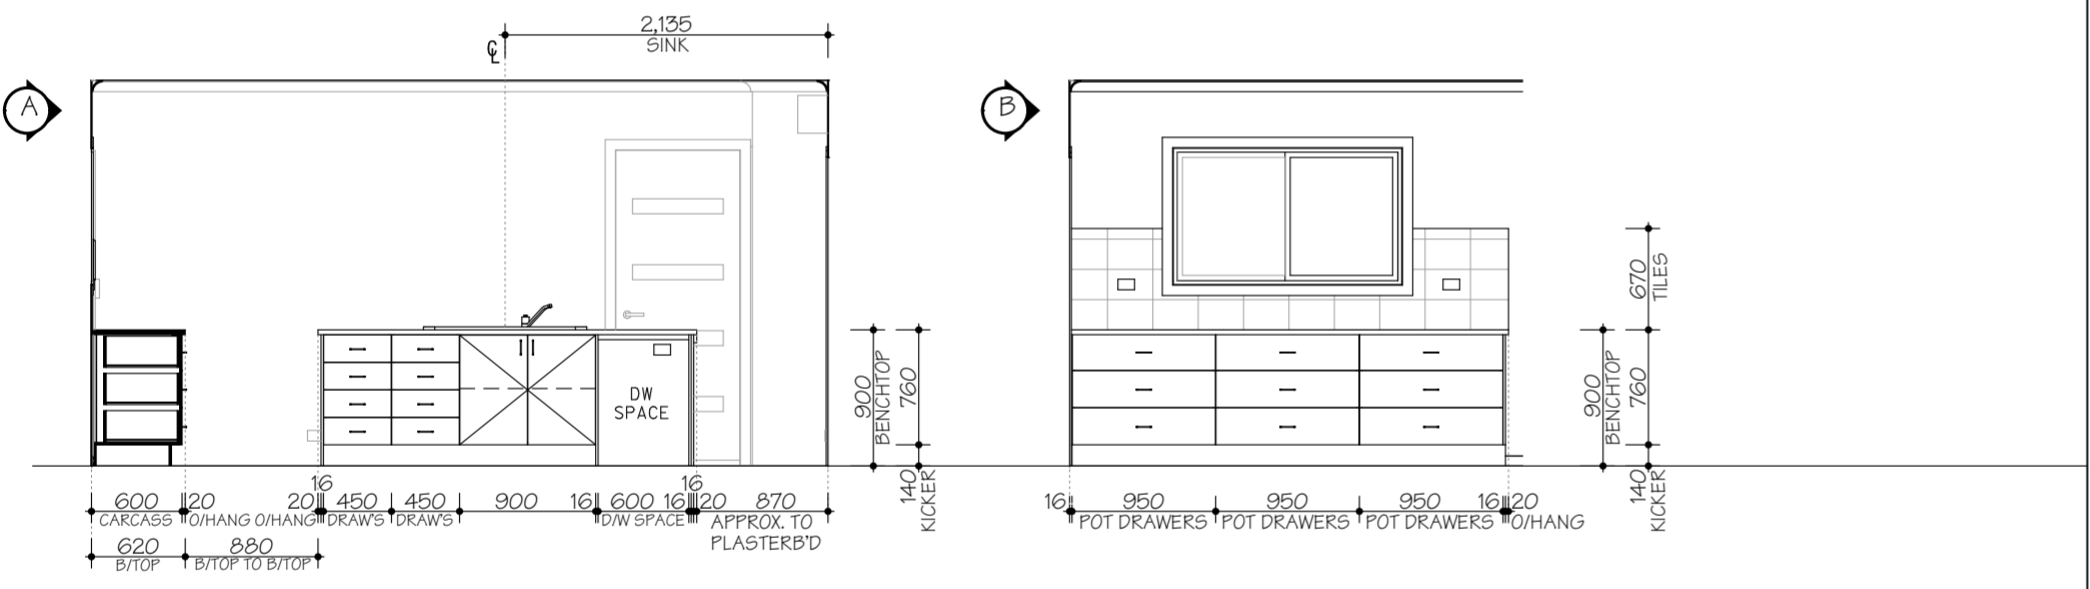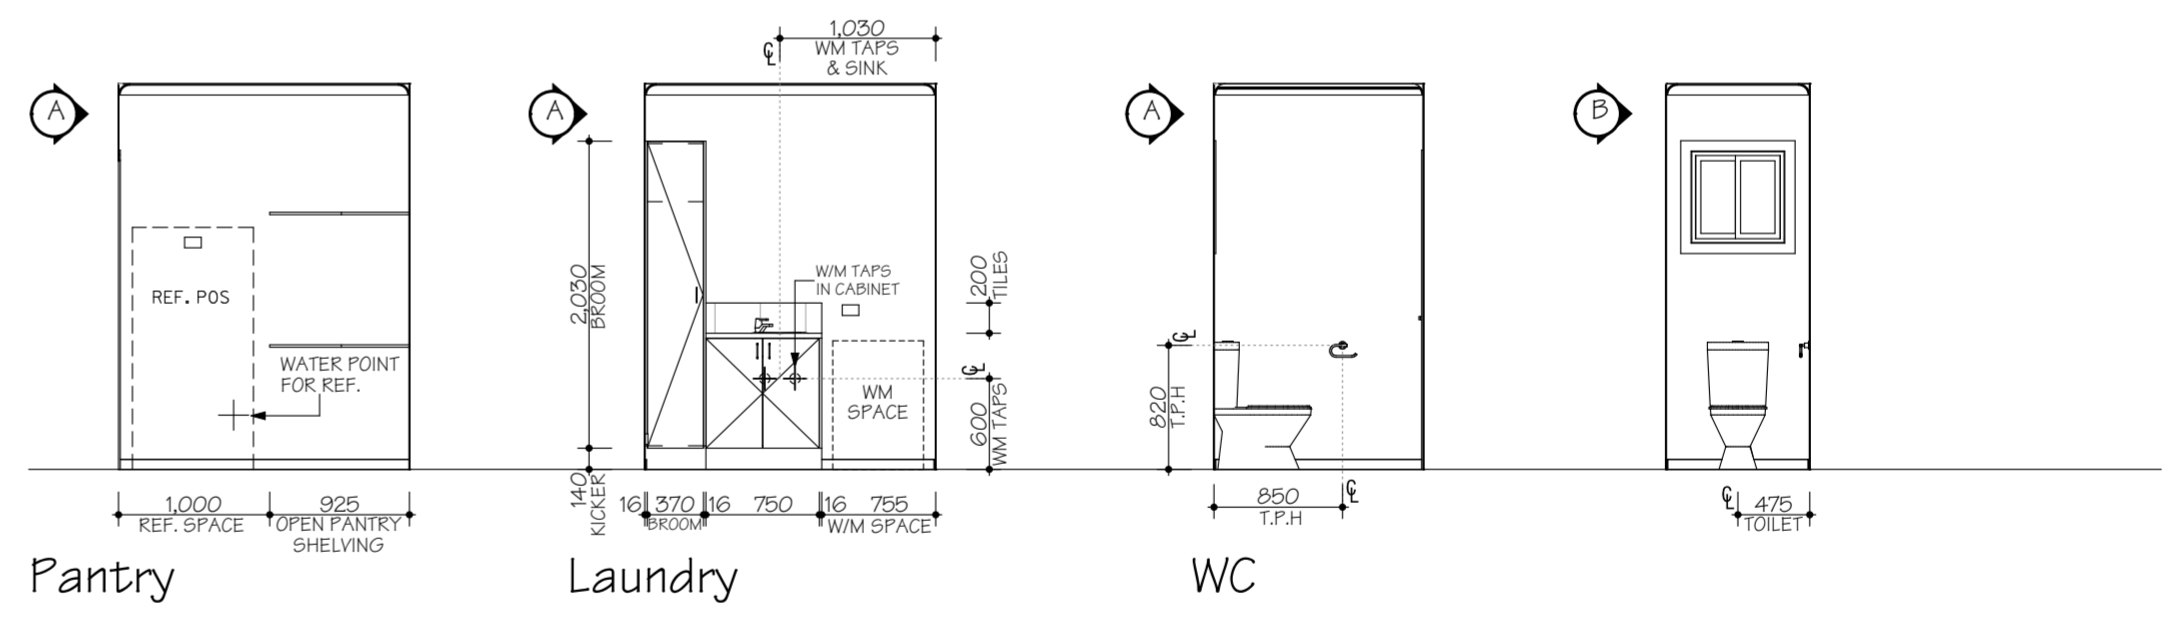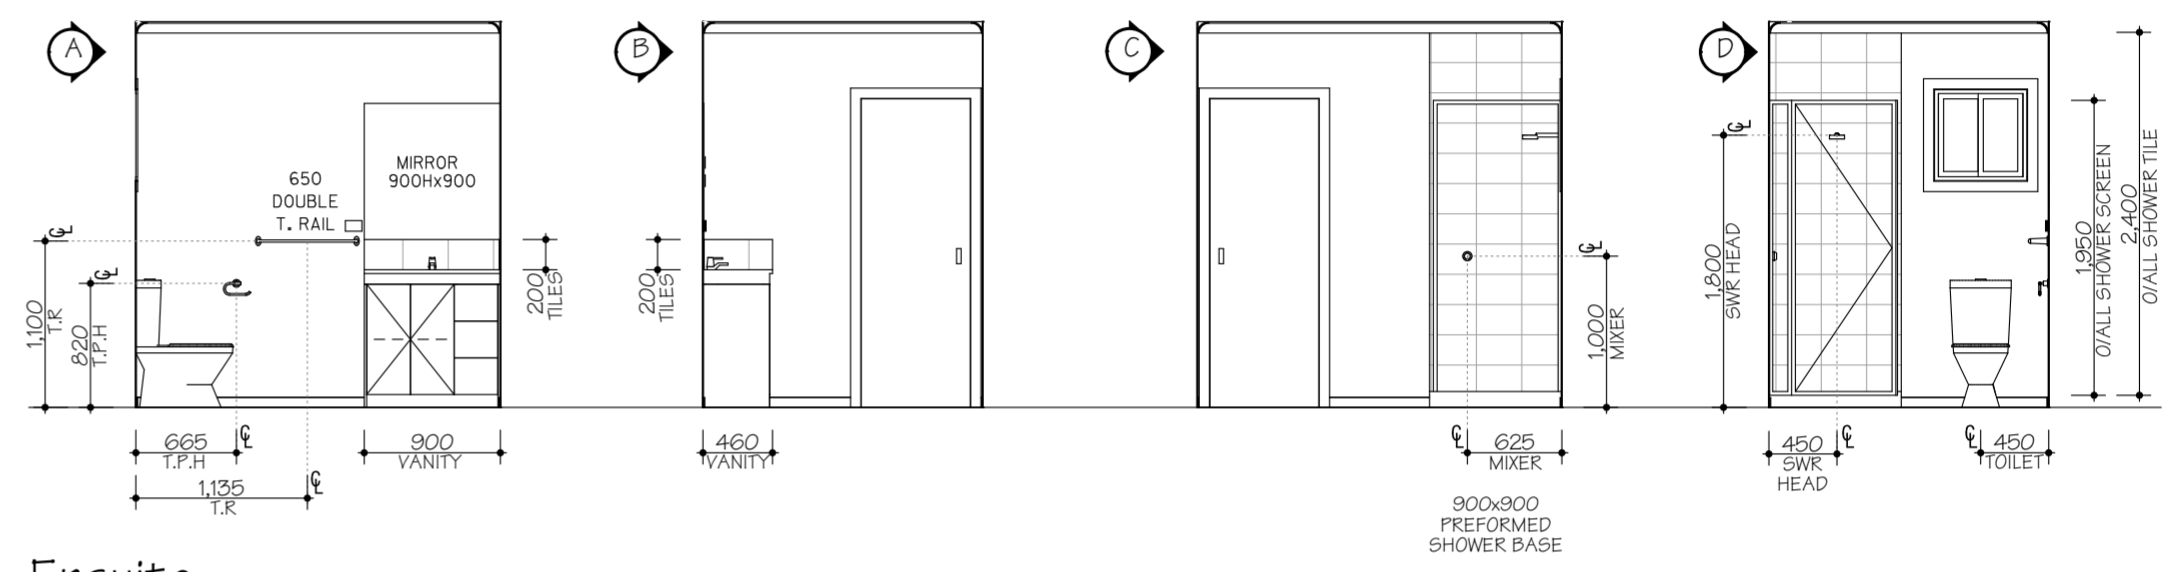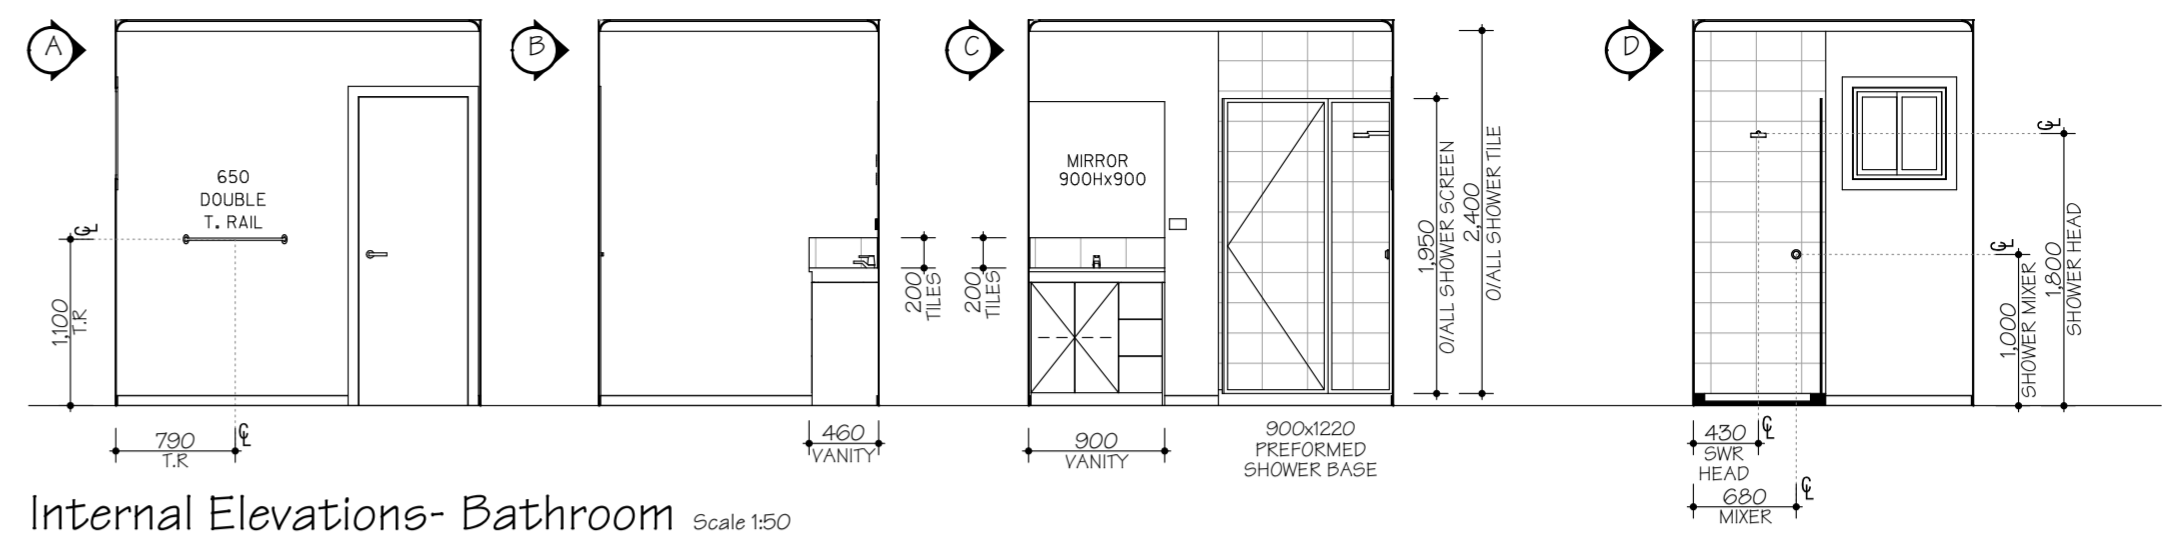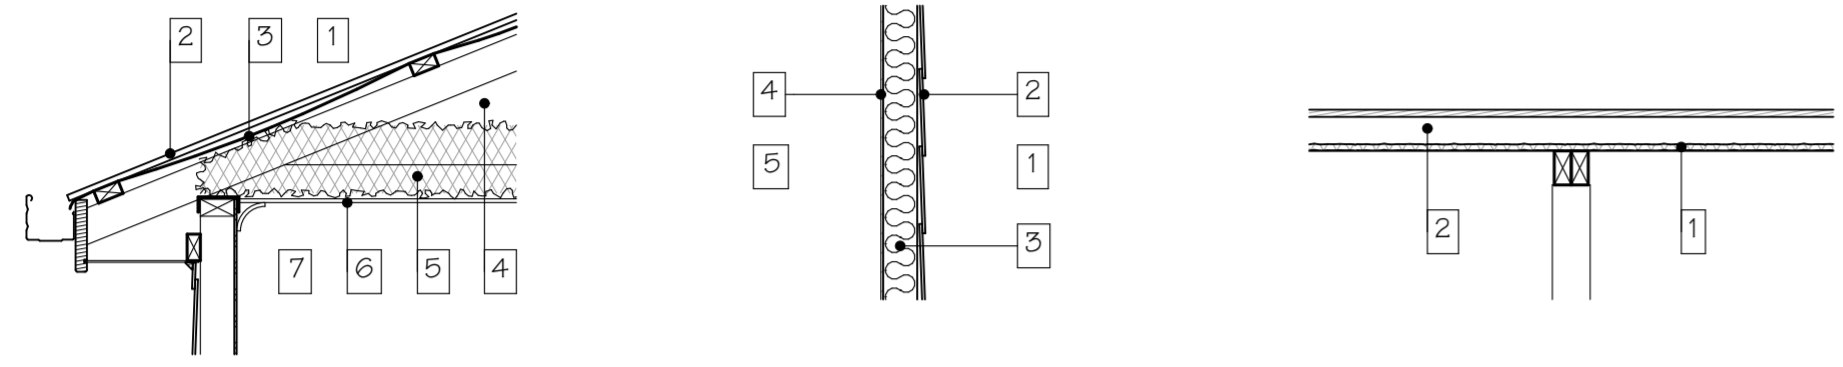

BAL 12.5
CONSTRUCTION IN ACCORDANCE WITH AS 3959-2009 FOR A BAL OF 12.5


I/WE
ACKNOWLEDGE THAT THESE PLANS ARE A TRUE AND ACCURATE REFLECTION OF OUR REQUIREMENTS AND AGREE THAT THESE PLANS ARE THE PLANS REFERRED TO IN THE MAJOR DOMESTIC BUILDING CONTRACT BETWEEN "BETNALE PTY LTD" (TRADING AS SUPERIOR GRANNY FLATS) AND MYSELF/OURSELVES AND AUTHORISE THEIR USE FOR NEXT STAGE PURPOSES. I/WE AM/ARE FULLY AWARE, IF ANY FURTHER CHANGES ARE TO BE MADE ON THESE PLANS WILL INCUR A VARIATION FEE.
SIGNED: DATE:
SIGNED: DATE:

Callen Bray
Building Design & Drafting
Residential - Commercial - Industrial
ABN: 38 040 205 161
Phone: 0419 441 186
Email: Callen_Bray@hotmail.com
Registered Building Practitioner: DP-AD 36967

Proposed DPU,
At: Lot 3 No. 14 Lower Somerville Road
Somerville VIC 3912
For: Betnale Pty. Ltd.


8.64m x 22.23m
2 Bedroom
+ Study

Sheet No: 4
Issue: 16/11/22
Rev: 1

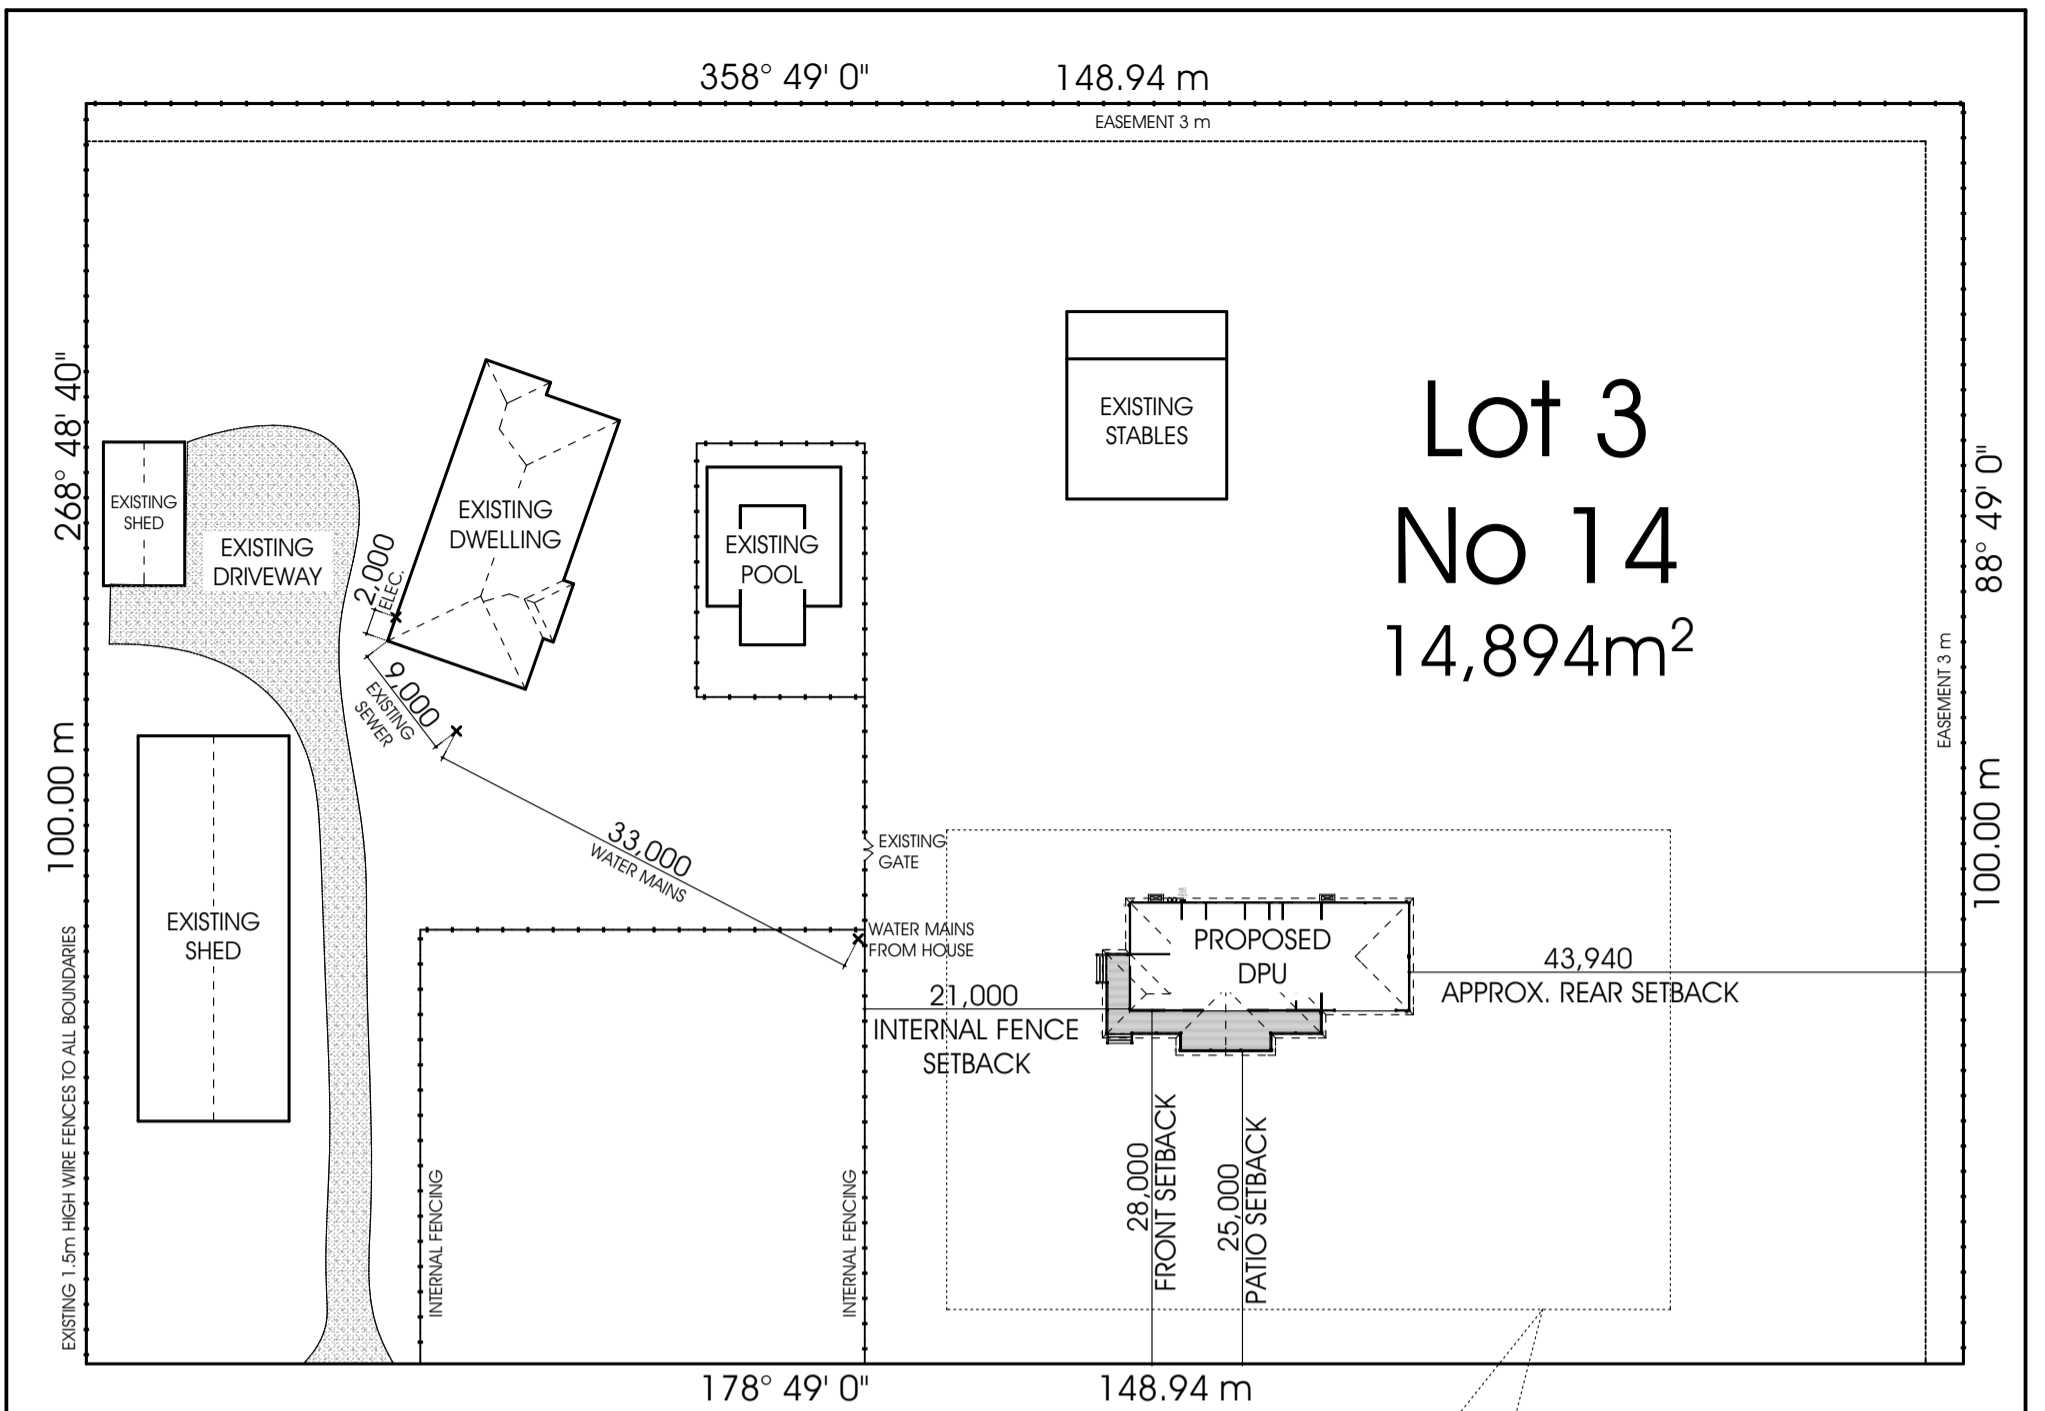

LOWER SOMERVILLE ROAD


Floor Plan
Scale 1:600

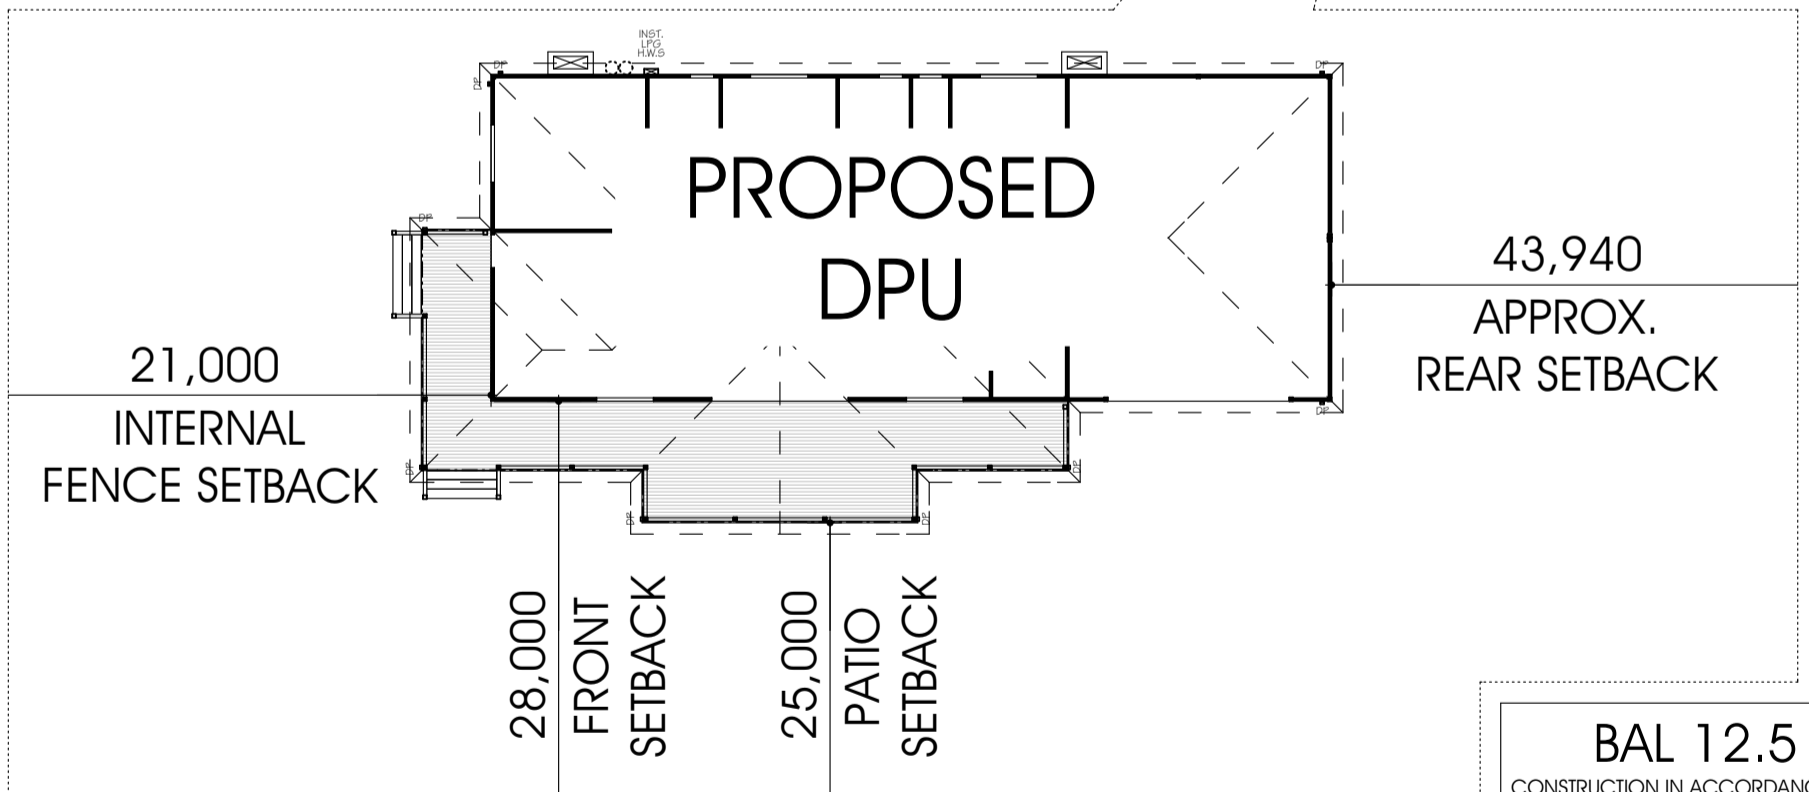

BAL 12.5
CONSTRUCTION IN ACCORDANCE WITH
AS 3959-2009 FOR A BAL OF 12.5

Enlarged Floor Plan
Scale 1:200

SITE COVERAGE DETAILS	
OVERALL SITE AREA:	14,894 m ²
EXISTING DWELLING:	272 m ²
EXISTING CLASS 10:	440 m ²
PROPOSED DPU:	192 m ² (+70%)
PROPOSED DPU PORCH:	50 m ²
OVERALL SITE COVERAGE:	954 m ² (7%)
TOTAL PERMEABLE AREA:	13,940 m ² (93%)



I/WE
ACKNOWLEDGE THAT THESE PLANS ARE A TRUE AND ACCURATE REFLECTION OF OUR REQUIREMENTS AND AGREE THAT THESE PLANS ARE THE PLANS REFERRED TO IN THE MAJOR DOMESTIC BUILDING CONTRACT BETWEEN "BETNALE PTY LTD" (TRADING AS SUPERIOR GRANNY FLATS) AND MYSELF/OURSELVES AND AUTHORISE THEIR USE FOR NEXT STAGE PURPOSES. I/WE AM/ARE FULLY AWARE, IF ANY FURTHER CHANGES ARE TO BE MADE ON THESE PLANS WILL INCUR A VARIATION FEE.
SIGNED: DATE:
SIGNED: DATE:





Callen Bray
BA(Arch), BArch, (Hons) (Deakin)
Building Design & Drafting
Residential - Commercial - Industrial
ABN: 38 040 205 161
Phone: 0419 441 186
Email: Callen_Bray@hotmail.com
Registered Building Practitioner: DP-AD 36967

Proposed DPU,
At: Lot 3 No. 14 Lower Somerville Road
Somerville VIC 3912
For: Betnale Pty. Ltd.


Site Plan

Sheet No: 5
Issue: 16/11/22
Scale: 1:600, 1:200
Rev: 1


Typical Ridge Detail
Scale 1:20

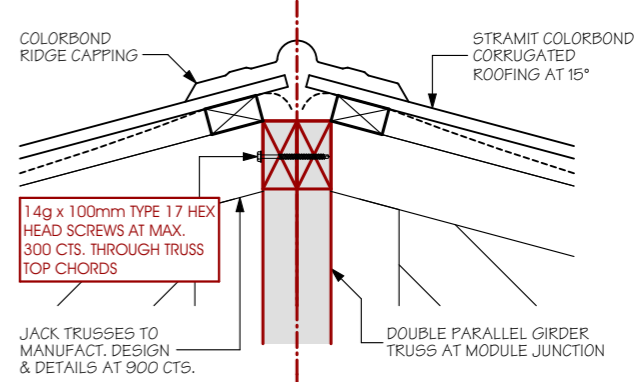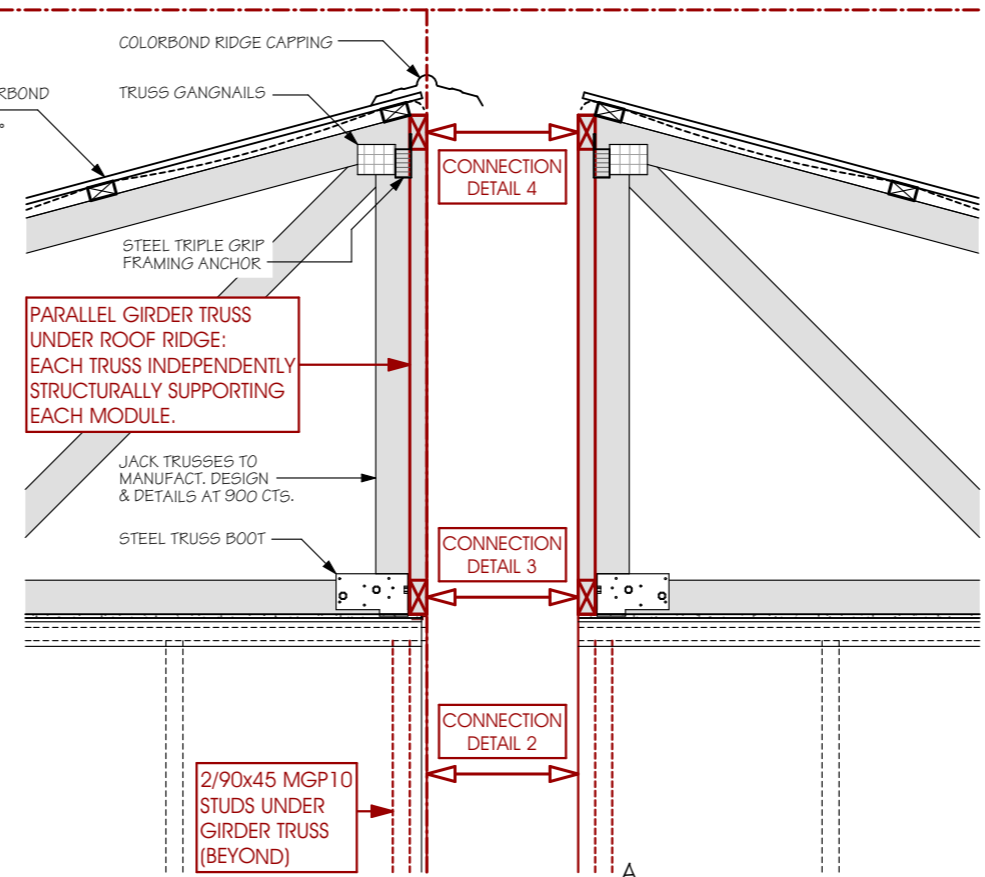


Connection Detail 4:
Roof Junction
Scale 1:10

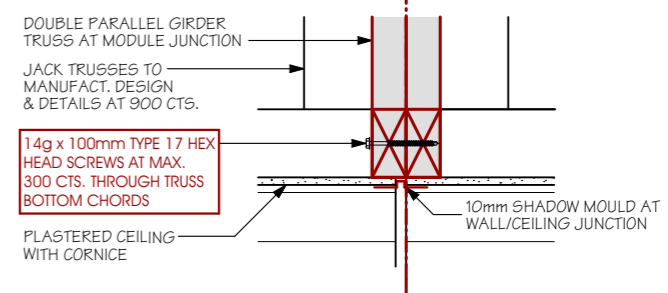

Connection Detail 3:
Roof Junction
Scale 1:10

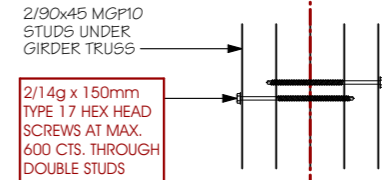


Connection Detail 2:
Wall Junction
Scale 1:10


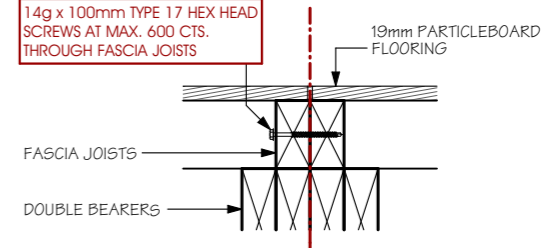


Connection Detail 1:
Floor Junction
Scale 1:10

Typical Eave
Wall-Roof Junction
Scale 1:20

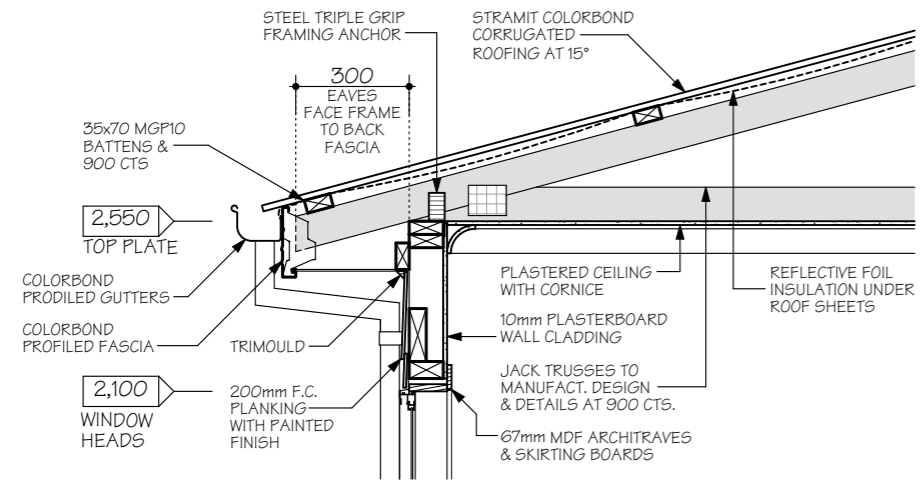

Typical Floor:
Wall-Floor Junction
Scale 1:20

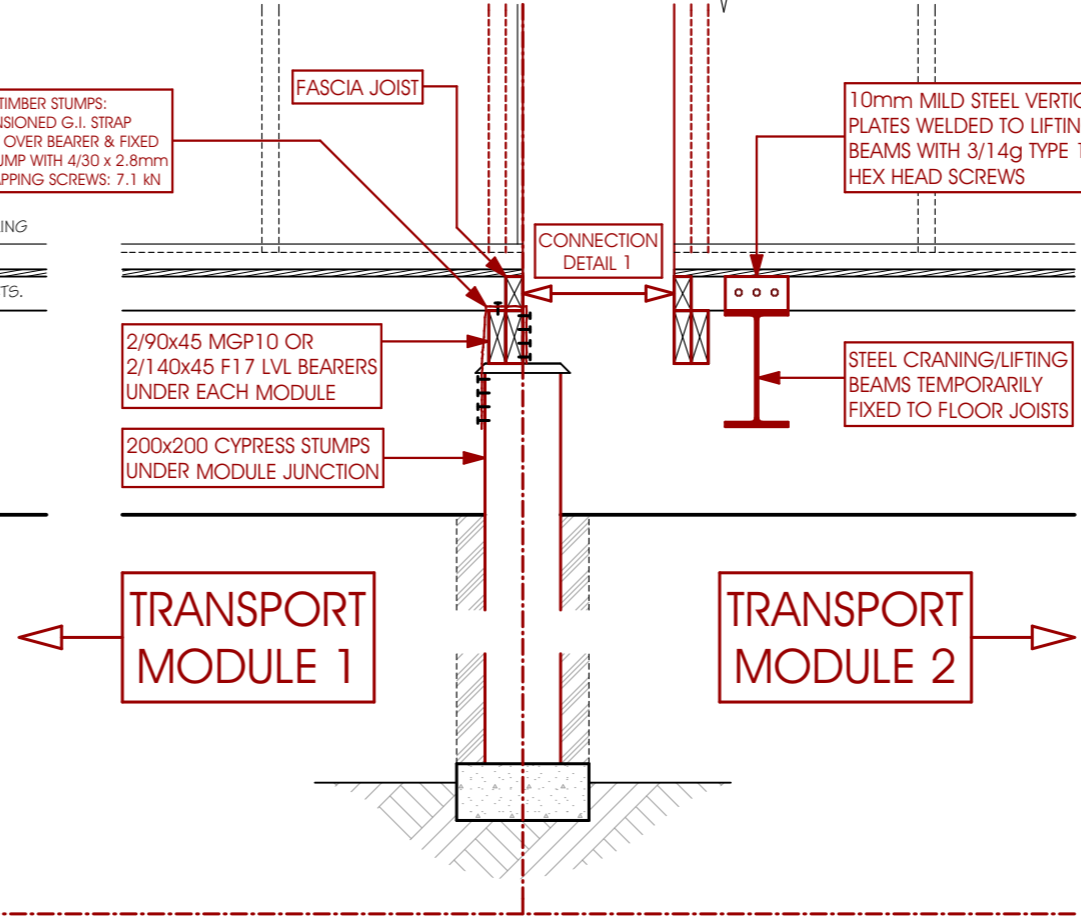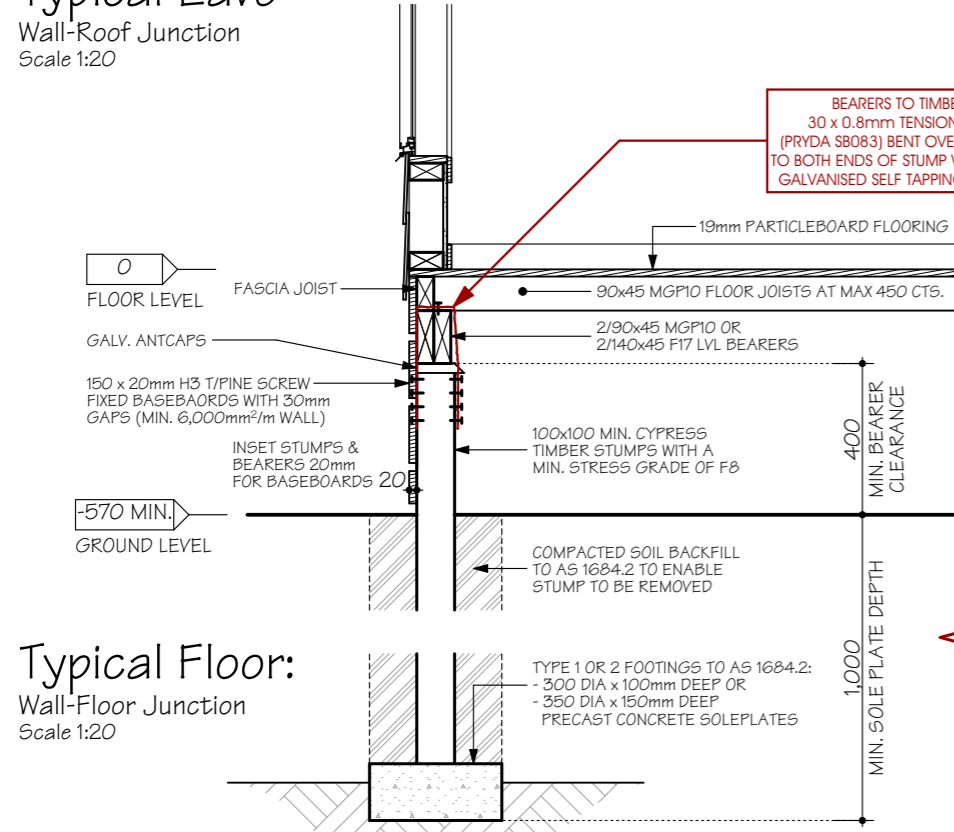

BAL 12.5
CONSTRUCTION IN ACCORDANCE WITH
AS 3959-2009 FOR A BAL OF 12.5





Callen Bray
BA(Arch), BArch.(Hons) (Deakin)
Building Design & Drafting
Residential - Commercial - Industrial
ABN: 38 040 205 161
Phone: 0419 441 186
Email: Callen_Bray@hotmail.com
Registered Building Practitioner: DP-AD 36967


Proposed DPU,
At: Lot 3 No. 14 Lower Somerville Rd
Somerville VIC 3912
For: Betnale Pty. Ltd.

Details

Sheet No: 6
Issue: 16/11/22
Rev: 1

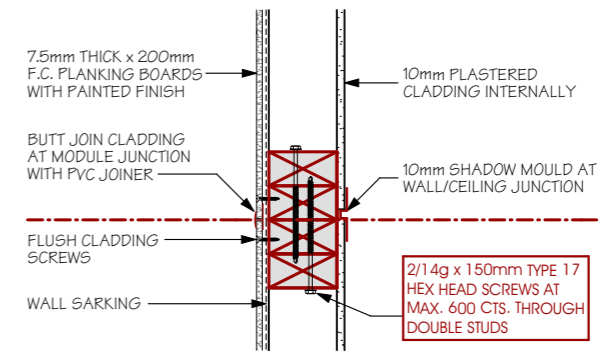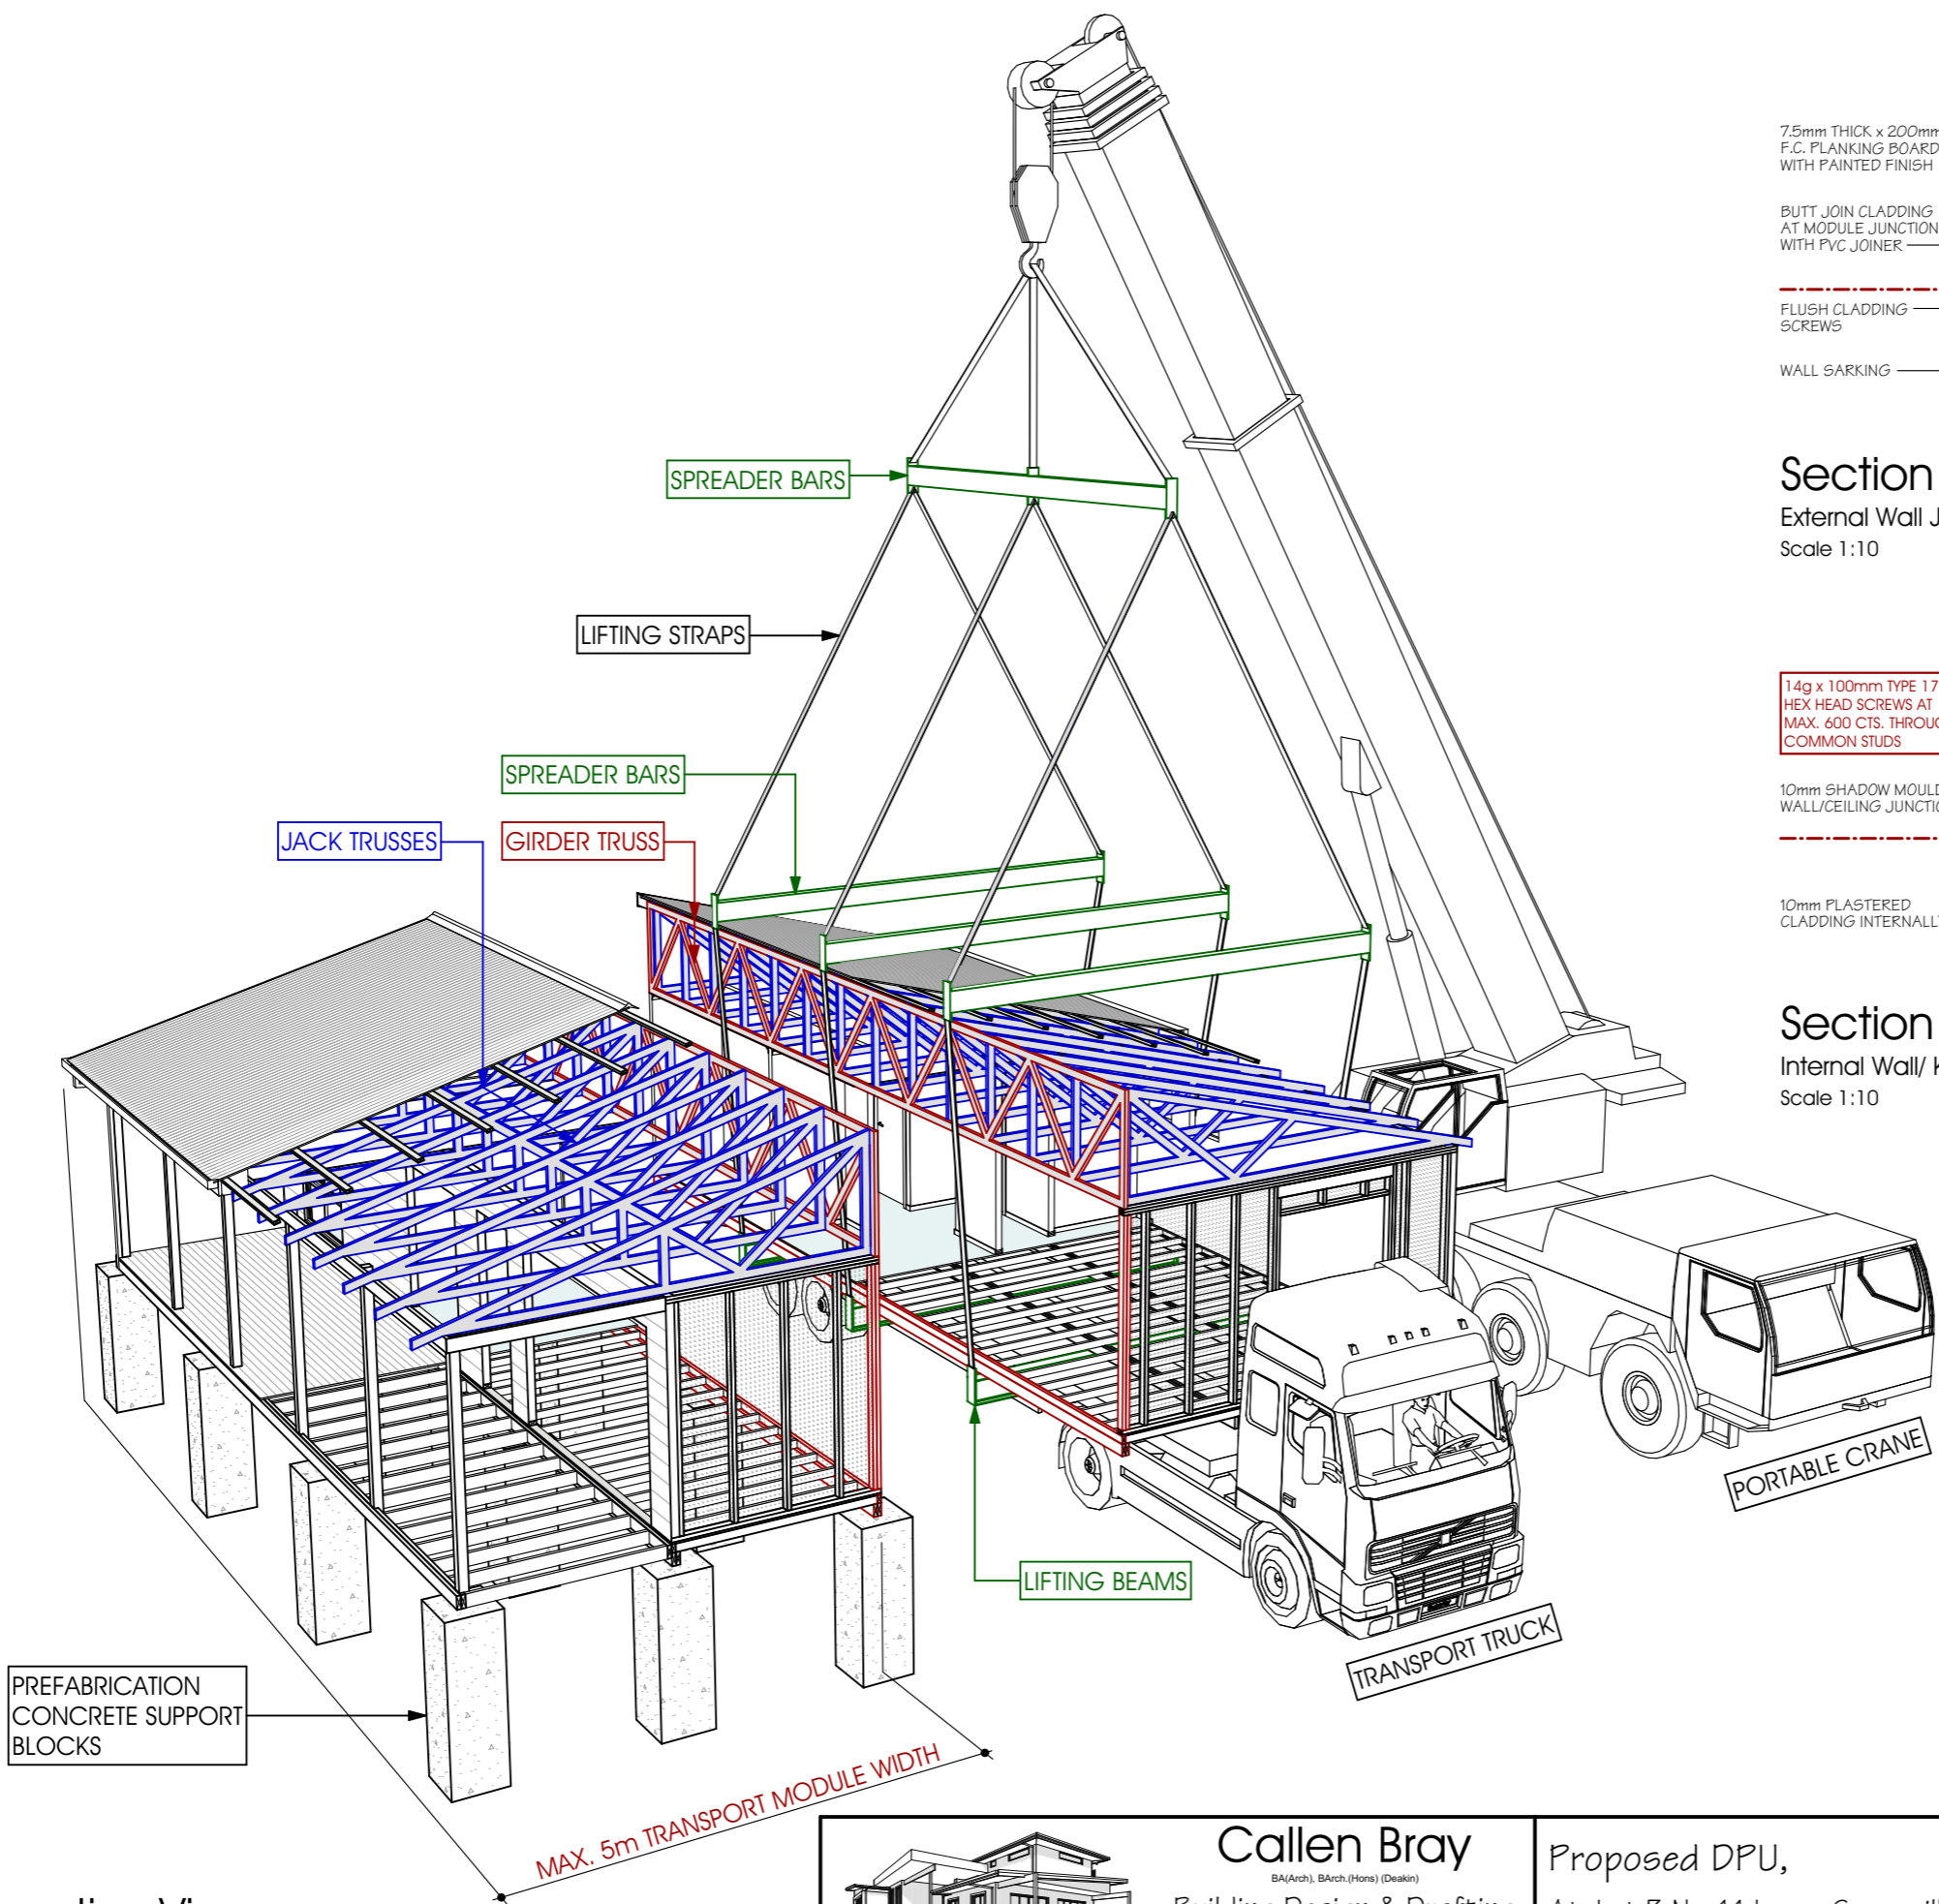


Section A:
External Wall Junction
Scale 1:10

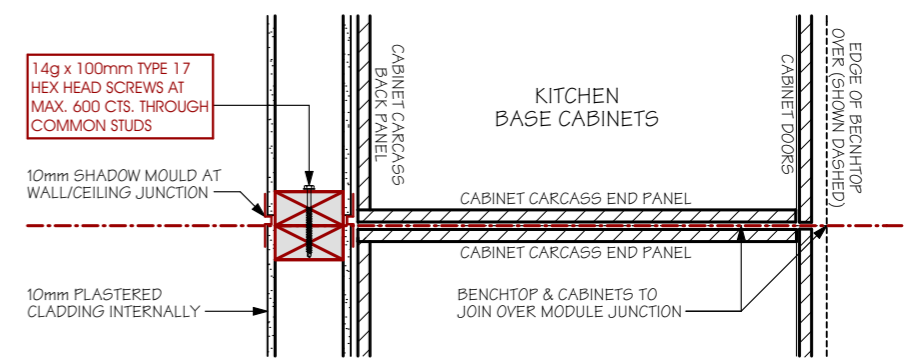

Section A:
Internal Wall/ Kitchen Cabinet Junctions
Scale 1:10

Perspective View
Scale NTS

BAL 12.5
CONSTRUCTION IN ACCORDANCE WITH AS 3959-2009 FOR A BAL OF 12.5

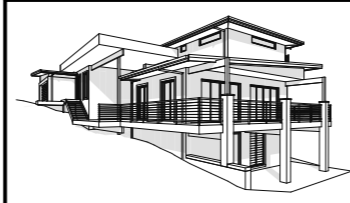

Callen Bray
BA(Arch), BArch.(Hons) (Deakin)
Building Design & Drafting
Residential - Commercial - Industrial
ABN: 38 040 205 161
Phone: 0419 441 186
Email: Callen_Bray@hotmail.com
Registered Building Practitioner: DP-AD 36967

Proposed DPU,
At: Lot 3 No. 14 Lower Somerville Rd
Somerville VIC 3912
For: Betnale Pty. Ltd.

Details 2

Sheet No: 7
Issue: 16/11/22
Rev: 1

BUSHFIRE PRONE AREA - BAL:12.5

CONSTRUCTION AS PER AS 3959-2009 FOR BAL LEVEL 12.5

SUBFLOOR SUPPORTS:

- NONE

FLOORS:

- NONE

EXTERNAL WALLS:

- MIN. 6mm F.C WALL CLADDING. ALL JOINTS TO BE COVERED, SEALED, OVERLAPPED, BACKED OR BUTT-JOINTED TO PREVENT GAPS GREATER THAN 3mm

VENTS:

- EXTERNAL VENTS FITTED WITH EMBER GUARDS OF MAX. 2mm APERTURE STAINLESS STEEL, BRONZE OR ALUMINIUM MESH.

WINDOWS & GLAZING:

- FLY SCREENS OR SECURITY SCREEN WHEN FITTED TO HAVE MAX. 2mm APERTURE S/STEEL, BRONZE OR ALUMINIUM MESH.
- FLY SCREEN OR SECURITY SCREEN FRAME WHEN FITTED TO BE EITHER METAL OR BUSHFIRE RESISTANT TIMBER OR A TIMBER SPECIES SPECIFIED IN PARAGHAPH E2, APPENDIX E.
- WINDOWS TO BE COMPLETELY PROTECTED BY A BUSHFIRE SHUTTER THAT COMPLIES WITH AS 3959 CLAUSE 5.5.1 OR
- WINDOWS TO BE COMPLETELY PROTECTED BY EXTERNAL SCREENS WITH MAX. 2mm APERTURE S/STEEL, BRONZE OR ALUMINIUM MESH WITH METAL OR BUSHFIRE RESISTANT TIMBER FRAME OR A TIMBER SPECIES SPECIFIED IN PARAGHAPH E2, APPENDIX E. OR
 - WINDOW FRAMES & JOINERY TO BE METAL OR BUSHFIRE RESISTANT TIMBER OR A TIMBER SPECIES SPECIFIED IN PARAGHAPH E2, APPENDIX E. AND
 - EXTERNALLY FITTED HARDWARE TO BE METAL. AND
 - GLAZING LESS THAN 400mm ABOVE THE GROUND OR DECK TO BE MIN. 4mm GRADE A SAFETY GLASS OR THICKER GLAZING MAY BE ANNEALED (EXTERNAL LEAF IN DOUBLE GLAZING ONLY) AND
 - OPENABLE PORTIONS OF ALL WINDOWS TO BE SCREENED INTERNALLY OR EXTERNALLY WITH MAX. 2mm APERTURE S/STEEL, BRONZE OR ALUMINIUM MESH WITH METAL OR BUSHFIRE RESISTANT TIMBER FRAME OR A TIMBER SPECIES SPECIFIED IN PARAGHAPH E2, APPENDIX E.

EXTERNAL DOORS:

- SIDE HUNG EXTERNAL DOORS AND DOOR FRAMES TO BE COMPLETELY PROTECTED BY A BUSHFIRE SHUTTER THAT COMPLIES WITH AS 3959 CLAUSE 5.5.1 OR

- BE PROTECTED EXTERNALLY BY SCREENS WITH MAX. 2mm APERTURE S/STEEL, BRONZE OR ALUMINIUM MESH WITH METAL OR BUSHFIRE RESISTANT TIMBER FRAME OR A TIMBER SPECIES SPECIFIED IN PARAGHAPH E2, APPENDIX E OR

- ALTERNATIVELY DOORS AND DOOR FRAMES COMPLY WITH THE FOLLOWING:

DOORS SHALL BE:

- NON-COMBUSTIBLE OR
- A SOLID TIMBER, LAMINATED TIMBER OR RECONSTITUTED TIMBER HAVING A MINIMUM THICKNESS OF 35mm FOR THE FIRST 400mm ABOVE THE THRESHOLD. OR
- A HOLLOW CORE DOOR WITH A NON-COMBUSTIBLE KICKPLATE ON THE OUTSIDE FOR THE FIRST 400mm ABOVE THE THRESHOLD OR
- BE PROTECTED EXTERNALLY BY SCREENS WITH MAX. 2mm APERTURE S/STEEL, BRONZE OR ALUMINIUM MESH WITH METAL OR BUSHFIRE RESISTANT TIMBER FRAME OR A TIMBER SPECIES SPECIFIED IN PARAGHAPH E2, APPENDIX E AND

- GLAZING PANELS LESS THAN 400mm ABOVE THE GROUND OR DECK TO BE MIN. 4mm GRADE A SAFETY GLASS OR THICKER GLAZING MAY BE ANNEALED AND

- DOOR FRAMES LESS THAN 400mm ABOVE THE GROUND OR DECK TO BE METAL OR BUSHFIRE RESISTANT TIMBER OR A TIMBER SPECIES SPECIFIED IN PARAGHAPH E2, APPENDIX E. AND

- DOORS SHALL BE TIGHT-FITTING TO THE DOOR FRAME. AND

- WEATHER STRIPS, DRAUGHT EXCLUDERS OR DRAUGHT SEALS SHALL BE INSTALLED AT THE BASE OF SIDE HUNG DOORS.

ROOF:

- NON-COMBUSTIBLE ROOFING (METAL) TO BE USED
- ROOF/WALL JUNCTIONS TO BE SEALED TO PREVENT GAPS GREATER THAN 3mm
- ROOF/GABLE/EAVES VENTS TO BE FITTED WITH EMBER GUARDS OF MAX. 2mm APERTURE S/STEEL, BRONZE OR ALUMINIUM MESH
- METAL ROOFS TO BE:
 - FULLY SARKED AND
 - HAVE GAPS GREATER THAN 3mm (UNDER CORRUGATIONS & RIBS) SEALED AT THE FASCIA OR WALL LINE WITH MAX. 2mm APERTURE STAINLESS STEEL/ BRONZE/ALUMINIUM MESH OR MINERAL WOOL INSULATION.

EAVES, FASCIAS & GABLES:

EAVES, BARGES & GABLE CLADDING TO BE:

- NON-COMBUSTIBLE OR
- MIN. 6mm FIBRE CEMENT OR
- BUSHFIRE RESISTANT TIMBER OR A TIMBER SPECIES SPECIFIED IN PARAGHAPH E2, APPENDIX E

- JOINS IN EAVES LININGS, FASCIAS AND GABLES MAY BE SEALED WITH PLASTIC JOINING STRIPS OR TIMBER STORM MOULDS

- JUNCTIONS TO BE SEALED TO PREVENT GAPS GREATER THAN 3mm OR SEALED WITH MAX. 2mm APERTURE S/STEEL, BRONZE OR ALUMINIUM MESH

GUTTERS & DOWNPIPES:

- IF INSTALLED, GUTTER GUARDS SHALL BE NON-COMBUSTIBLE

DECKS, STEPS & LANDINGS:

- MATERIALS USED TO ENCLOSE THE SUB-FLOOR THAT ARE LESS THAN 400mm ABOVE THE GROUND MUST BE:

- NON-COMBUSTIBLE OR
- MIN. 6mm FIBRE CEMENT OR
- BUSHFIRE RESISTANT TIMBER OR A TIMBER SPECIES SPECIFIED IN PARAGHAPH E1, APPENDIX E

- DECKING AND STAIR TREADS THAT ARE LESS THAN 400mm BELOW GLAZING ELEMENTS BE NON-COMBUSTIBLE OR BUSHFIRE RESISTANT TIMBER OR A TIMBER SPECIES SPECIFIED IN PARAGHAPH E1, APPENDIX E

BALUSTRADES & HANDRAILS:

- NONE

WATER & GAS SUPPLY PIPES:

- WHEN EXPOSED AND ABOVE GROUND MUST BE METAL

BUSHFIRE RESISTANT TIMBER:

- SILVERTOP ASH
- BLACKBUTT
- RIVER RED GUM
- SPOTTED GUM
- RED IRONBARK
- MERBAU (KWILA)
- TURPENTINE

ABOVE GROUND EXPOSED TIMBER MUST ALSO BE DURABILITY CLASS 1 OR 2:

- PARAGHAPH E1, APPENDIX E COMPATIBLE SPECIES (GENERAL CONSTRUCTION):

- BELIAN
- BLACKBUTT
- MERBAU (KWILA)
- IRONBARK (RED & GREY)
- TALLOWOOD
- MERBAU (KWILA)
- TURPENTINE
- RIVER RED GUM
- BALAU
- NORTHERN BOX

- PARAGHAPH E2, APPENDIX E COMPATIBLE SPECIES (WINDOWS & DOORS):

- BELIAN
- BLACKBUTT
- CYPRESS
- MERBAU (KWILA)
- IRONBARK (RED & GREY)
- SPOTTED GUM
- TALLOWOOD
- TURPENTINE
- RIVER RED GUM
- BALAU
- NORTHERN BOX

- BUSHFIRE RESISTANT TIMBER SPECIES:

- BLACKBUTT
- MERBAU (KWILA)
- RIVER RED GUM
- SPOTTED GUM
- TURPENTINE


- ABOVE GROUND PROTECTED OR EXPOSED & PAINTED

PARAGHAPH E2, APPENDIX E COMPATIBLE SPECIES (WINDOWS & DOORS):

- MOUNTAIN ASH (VIC ASH, TASMANIAN OAK)

BAL 12.5

CONSTRUCTION IN ACCORDANCE WITH
AS 3959-2009 FOR A BAL OF 12.5

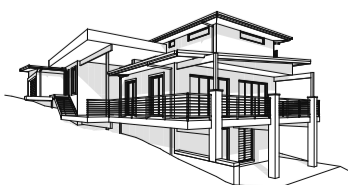

Callen Bray

BA(Arch), BArch.(Hons) (Deakin)

Building Design & Drafting
Residential - Commercial - Industrial

ABN: 38 040 205 161
Phone: 0419 441 186
Email: Callen_Bray@hotmail.com
Registered Building Practitioner: DP-AD 36967

Proposed DPU,

At: Lot 3 No. 14 Lower Somerville Road
Somerville VIC 3912

For: Betnale Pty. Ltd.

BAL 12.5

Sheet No: 8
Issue: 16/11/22
Scale:
Rev: 1