

**SPECIFICATION**

**FOOTINGS**  
 -TYPE 2' FOOTINGS TO AS 1684.2  
 350mm DIA. x 150mm DEEP PRECAST CONCRETE SOLE PLATES

**MIN. SOLE PLATE FOUNDING DEPTHS:**  
 IN ACCORDANCE WITH AS 2870

**SITE CLASSIFICATION**

MIN. DEPTH
A, S, M
M-D
H

NOTE: SOLE PLATES MUST ALSO BE FOUND ON A MIN. OF 100mm INTO NATURAL SOIL WITH A MIN. BEARING CAPACITY OF 100 kPa. A DEEPER FOUNDING DEPTH MAY BE REQUIRED TO ACHIEVE THIS

**STUMPS**  
 -100x100 MIN. TIMBER STUMPS OF A DURABILITY CLASS 1 OR 2 OR H5 TREATED WITH A MIN. STRESS GRADE OF F4

**BEARERS**  
 ROOF LOAD WIDTH- MAX. 4655mm  
 FLOOR LOAD WIDTH- 1725mm INTERNALLY - 1825mm MAX. ON EXT. WALLS

-2/140x45 LVL 15 (F17) BEARERS WITH A MAX. CONTINUOUS SPAN OF 2,900mm

**MINIMUM BEARER CLEARANCE TO GROUND LEVEL:**

TERMITE INSPECTION NOT REQUIRED: 150mm  
 REQUIRED: 400mm

NOTE: ON SLOPING SITES, 400mm WHEN REQUIRED MAY BE REDUCED TO 150mm WITHIN 2m OF EXTERNAL WALLS

**FLOOR JOISTS**  
 -90x45 MGP10 FLOOR JOISTS AT MAX. 450 CENTRES WITH A MAX. CONTINUOUS SPAN OF 1800mm  
 MAX. SINGLE SPAN OF 1300mm OR

90x45 F5 FLOOR JOISTS AT MAX. 450 CENTRES WITH A MAX. CONTINUOUS OF 1600mm

**FLOORING**  
 19mm THICK "YELLOW TONGUE" PARTICLEBOARD FLOORING.

**TIMBER DURABILITY**  
 CLASS 1 OR 2 TIMBERS ARE SUITABLE FOR IN GROUND USE. ALTERNATIVELY, H5 TREATED TIMBER CAN BE USED

CLASS 1	CLASS 2
BELIAN CYPRESS (WHITE) IRONBARK TALLOWWOOD TURPENTINE YELLOW CEDAR NORTHERN BOX	BLACKbutt KAILA (MERBAU) SPOTTED GUM WESTERN RED CEDAR RIVER RED GUM BALAU TEAK

**WALL FRAMES**

COMMON STUDS: 90x25 F5 AT 600 CTS.  
 TOP/BOTTOM FLATES: 45x90 F5  
 NOGGINGS: 90x25 AT 1275 CTS.  
 JAMB STUDS: 90x25 F5  
 OPENING 0 - 900: 2/90x25 F5  
 OPENING 900 - 2600: 3/90x25 F5  
 OPENING 2600 - 4300:

**LINTELS**  
 -OPENINGS UP TO 1100: 90 x 45 F5  
 -OPENINGS UP TO 1500: 90 x 45 LVL 15  
 -OPENINGS UP TO 1800: 140 x 45 F7  
 -OPENINGS UP TO 2200: 140 x 45 LVL 15  
 -OPENINGS UP TO 2400: 190 x 45 F7  
 -OPENINGS UP TO 2600: 190 x 45 MGP10  
 -OPENINGS UP TO 3000: 240 x 45 F7

\*ALL STRUCTURAL TIMBER SIZES, FIXINGS & TIE-DOWNS ARE TO BE IN ACCORDANCE WITH AS 1684.2 2010

**WATERPROOFING & WATER RESISTANCE**

ALL WET AREA FLOORS:

- ENSURE VINYL FLOORING IS DEEMED TO BE WATERPROOF & THAT ALL JOINS ARE SEALED
- UPTURN VINYL MIN. 25mm AT WALL/FLOOR JUNCTIONS TO CREATE WATERPROOF WATER STOP. SKIRTING BOARDS & ARCHITRAVES PLACED OVER UPTURN & SEALED TO VINYL WITH WATERPROOF ACRYLIC OR SILICONE SEALANT (REFER TO DETAIL)
- SKIRTING BOARDS & ARCHITRAVES TO WET AREAS TO BE SOLID TIMBER (IE. PINE OR HARDWOOD, NOT MDE)

**SHOWER CUBICLE:**

- 42x42mm ALLUMIN. WATERSTOP ANGLE OR VINYL FLOORING STOP WITH MIN. HORIZONTAL DIMENSION OF 40mm EITHER SIDE, SEALED TO WALL AT ALL WALL JUNCTIONS (CORNERS) EXTENDING A MIN. OF 1800mm FROM SHOWER BASE
- THERMOSET LAMINATE WALL PANELS MIN. OF 1800mm HIGH FROM SHOWER BASE

ABOVE BASINS, TROUGHES & SINKS (KITCHEN BENCH)

- 150mm HIGH WALL TILES MIN. ABOVE VESSELS WITH WATERPROOF ACRYLIC OR SILICONE SEALANT TO JUNCTIONS

**ELECTRICAL NOTES**

- LIGHT SWITCHES TO BE AT 1000mm ABOVE FLOOR LEVEL.
- HEIGHTS OF POWER POINTS MEASURED FROM FLOOR LEVEL UNLESS OTHERWISE NOTED.
- UNLESS DIMENSIONED POWER POINTS TO BE LOCATED TO THE NEAREST STUD.
- POWER POINTS FOR APPLIANCES & SPLIT SYSTEM AIR-CONDITIONING TO SUIT MANUFACTURERS REQ.
- PROVIDE PHONE CABLING WITH CONDUIT & DRAW STRING PLUS TV. ANTENNA CABLING THROUGH BARGE END.

**ENERGY EFFICIENCY- LIGHTING**

- ARTIFICIAL LIGHTING MUST NOT EXCEED: CLASS 1 BUILDINGS- 5 W/m<sup>2</sup> VERANDAH/FLOOR- 4W/m<sup>2</sup> PERIMETER LIGHTING- MIN. 40 LUMENS/W IN ACCORDANCE WITH THE B.C.A PART 3.12
- INTERNAL LIGHTING MUST NOT EXCEED: 590 WATTS TOTAL
- PERIMETER LIGHTING COMPLIANT WITH: 8 WATT CFL GLOBE= 50 LUMENS/W 11 WATT CFL GLOBE= 73 LUMENS/W

**ELECTRICAL LEGEND**

○	- CEILING LIGHT OUTLET (240V)	▼	- PHONE POINT AT 200/1000
●	- LED DOWNLIGHT	⊙	- SMOKE DETECTOR (DIRECT WIRED)
⊗	- EXHAUST FAN (SELF SEALING)	⊕	- TV. POINT AT 200
S/B	- INTERNAL SWITCH BOARD		

SPP	DPP	HEIGHT	SPP	DPP	HEIGHT
☀	☀	200 F.F.L	☀	☀	1200 F.F.L
☀	☀	350 F.F.L	☀	☀	1275 F.F.L
☀	☀	750 F.F.L	☀	☀	1350 F.F.L
☀	☀	970 F.F.L	☀	☀	1400 F.F.L
☀	☀	1000 F.F.L	☀	☀	2000 F.F.L
☀	☀	1000 F.F.L	☀	☀	IN ROOF

**TERMITE AREAS**  
 THE PLACEMENT OF A CHEMICAL BARRIER OR SHEET METAL "ANT CAPS" TO THE TOPS OF TIMBER STUMPS IN ACCORDANCE WITH PART 3.1.3 OF THE BCA & AS 3660.1 IS SUFFICIENT WHEN PROTECTION AGAINST TERMITE ATTACK IS REQUIRED

NOTE: A MIN. OF 400mm CLEARANCE IS REQUIRED TO THE UNDERSIDE OF BEARERS ON SITES REQUIRING TERMITE INSPECTION. THIS CAN BE REDUCED TO 150mm ON SLOPING SITES WITHIN 2m OF EXTERNAL WALLS.


**BUSHFIRE AREAS**  
 DESIGN & SPECIFICATION DOES NOT CONSIDER SITES SUBJECT TO BUSHFIRE ATTACK. SITES DEEMED TO HAVE A BAL OF 12.5 OR MORE HAVE ADDITIONAL CONSTRUCTION REQUIREMENTS IN ACCORDANCE WITH PART 3.7.4 OF THE BCA & AS 3959

**INTERNAL ELEVATIONS SPECIFICATION**

WATER PIPE LOCATIONS				FITTING LOCATIONS			
No.	ITEM	ABOVE FFL	No.	ITEM	ABOVE FFL	ITEM	HEIGHT ABOVE FFL
1	TOILET	250	6	SINK	650	PAPER HOLDER	820
2	BIDET	250	7	DW	500	TOWEL RAIL	1000/1600
3	BATH	600	8	TROUGH	1085	TOWEL RING	820
4	SHOWER	1000/1800	9	WM	600/1275	SHOWER SOAP HOLDER	1000 NOMINAL
5	BASIN	600	10	FR WASTE	-		

FRAME OFFSETS: SHOWER ROSE= 430 CL, SHOWER TAPS= 250 CL, SOAP HOLDER= 550 CL

NOTES:  
 - DIMENSIONS TAKEN FROM FRAME  
 - SPLASHBACK TILES: 200x200  
 - WET AREA SKIRTING BOARDS: SOLID TIMBER 67mm  
 - POWERPOINT LOCATION

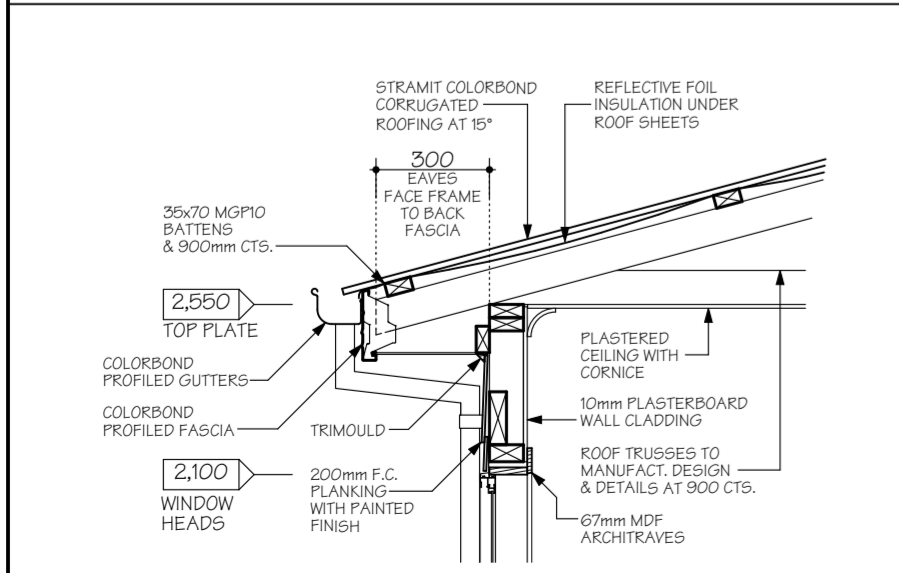


**INTERNAL ELEVATIONS SPECIFICATION**

**FLOOR AREAS**

GRD. FL.	118.0m <sup>2</sup>
SUB TOTAL	118.0m <sup>2</sup>
VER./POR.	42.0m <sup>2</sup>
TOTAL	160.0m <sup>2</sup>

**FLOOR COVERING AREAS**

CARPET	31.3 m <sup>2</sup>
HYBRID	70.5 m <sup>2</sup>
TILES	6.3 m <sup>2</sup>

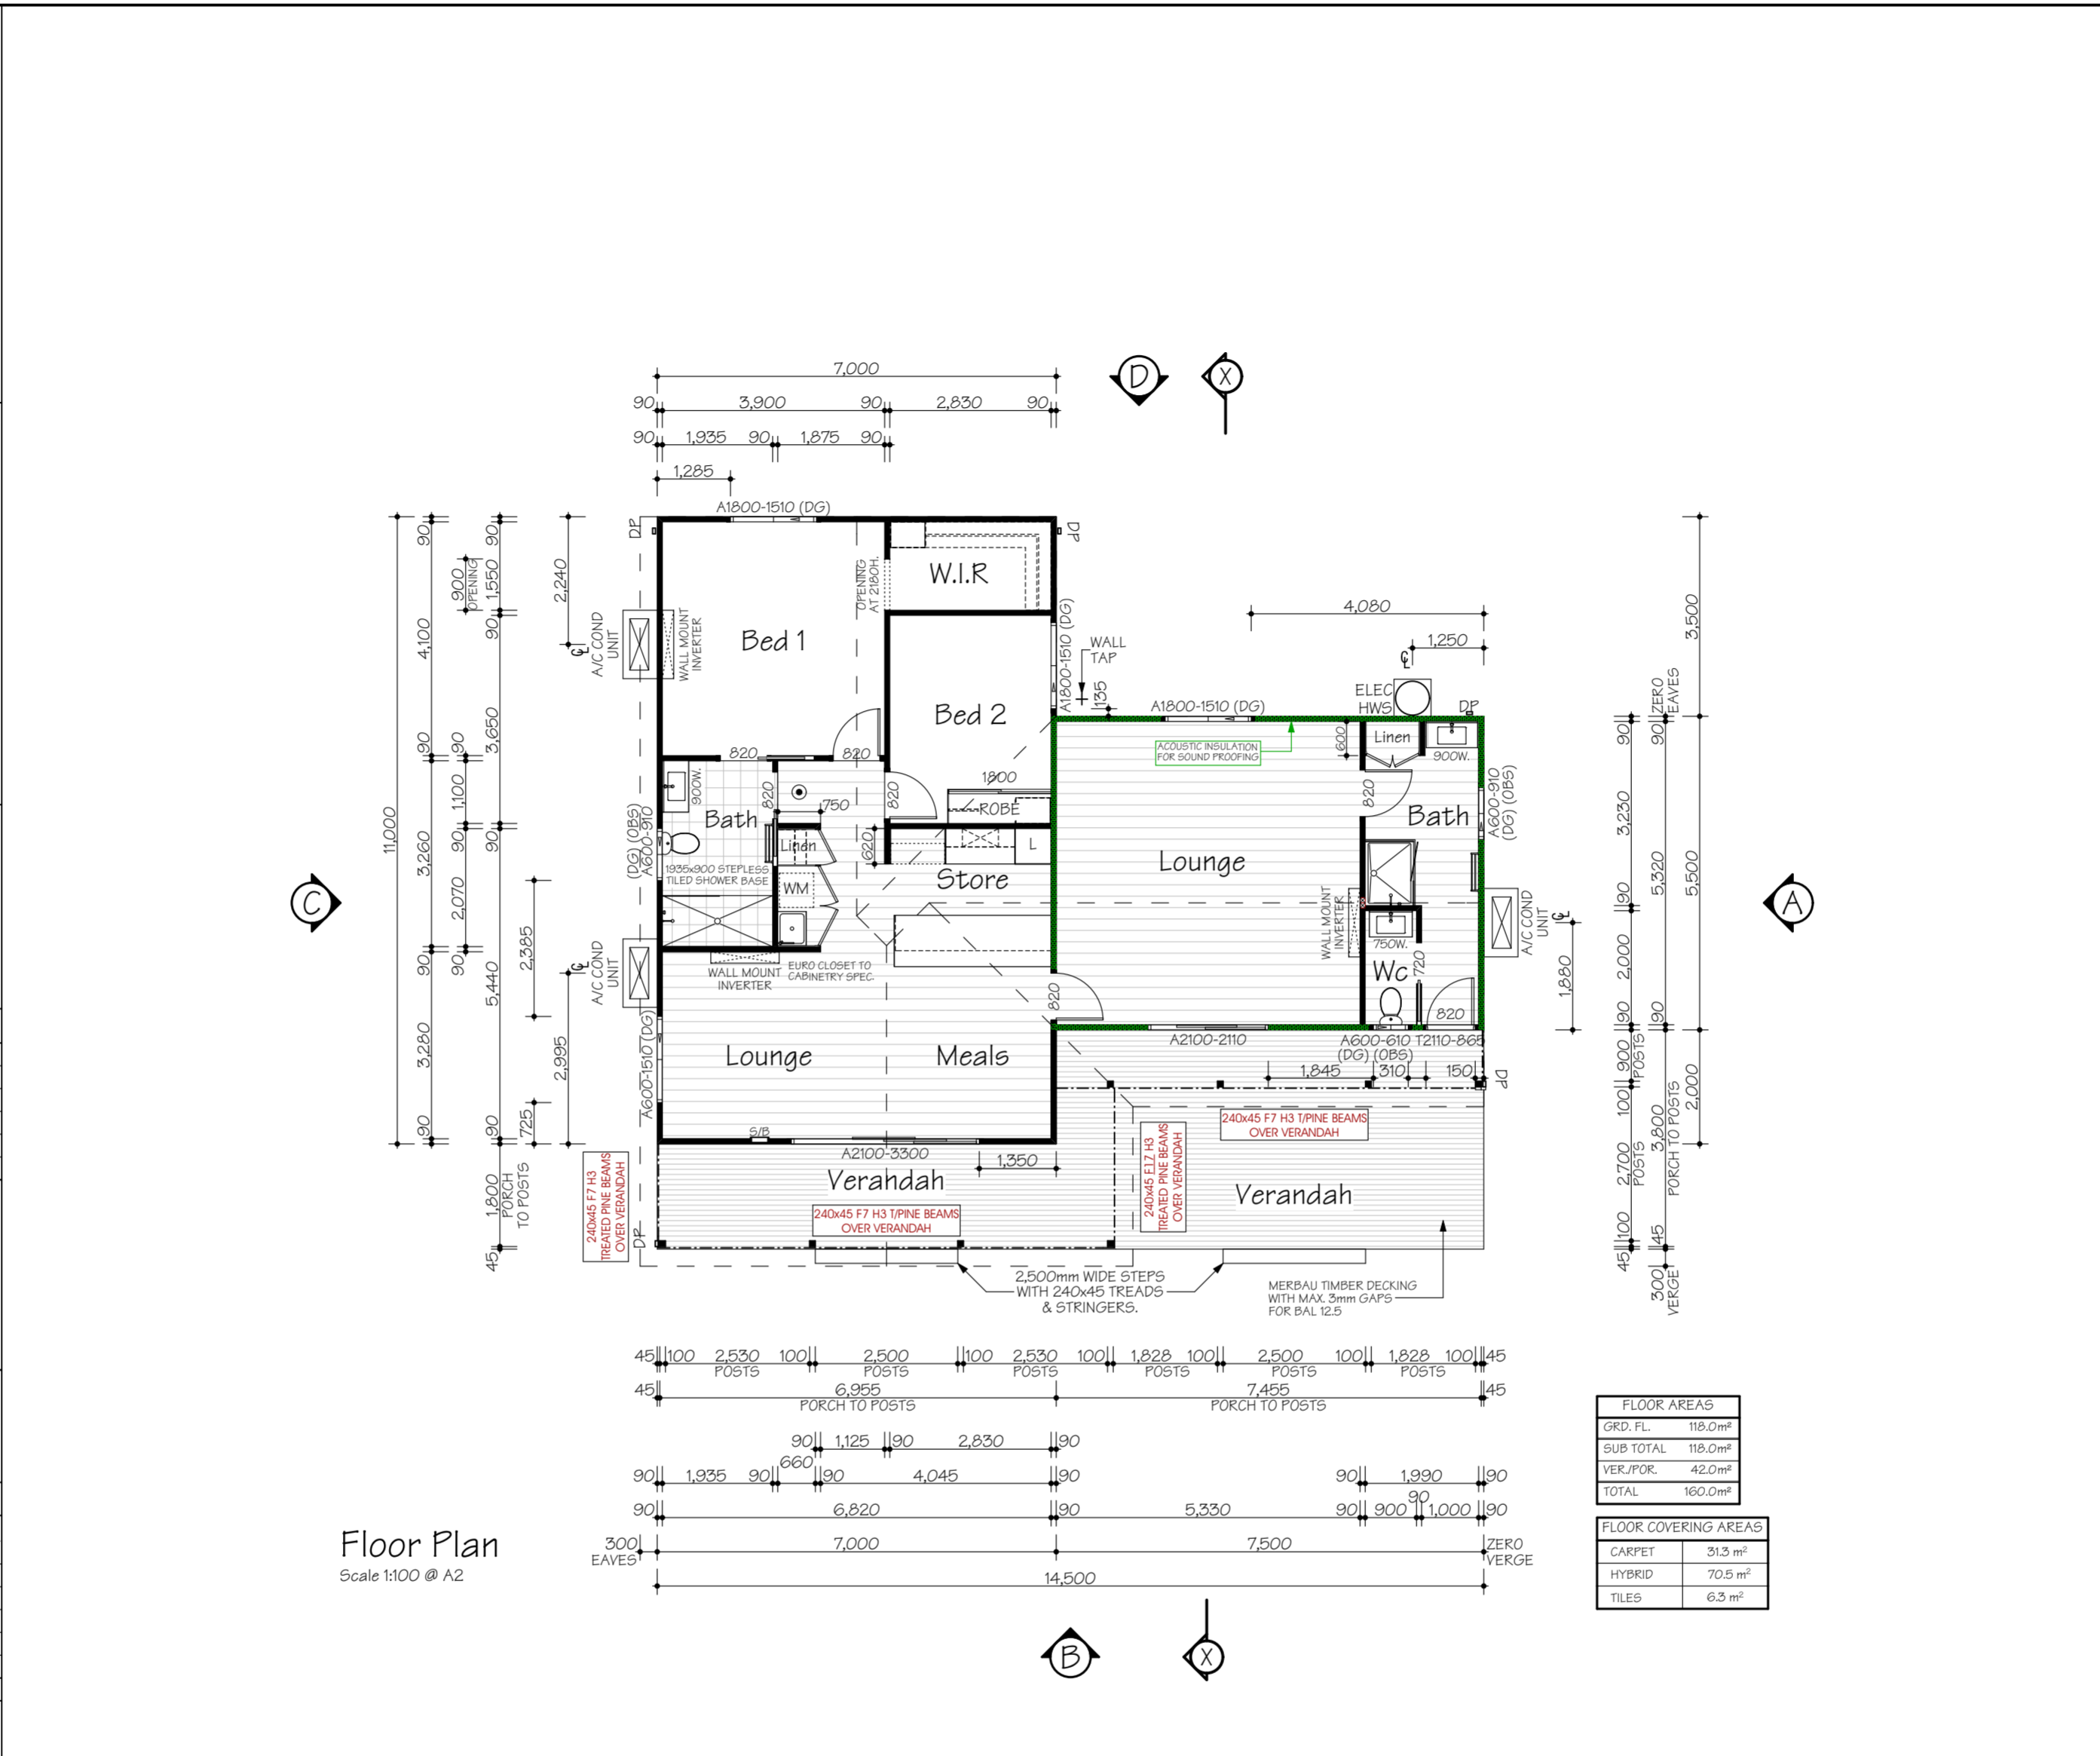

**Shower Detail**  
 Check into Wall  
 Scale 1:5 @ A2

Labels: 10mm WATER RESISTANT P/B BOARD SUBSTRATE, THERMOSET LAMINATE PANEL, WATERPROOF SEALANT, MIN. CHECK OUT.

**ACKNOWLEDGE THAT THESE PLANS ARE A TRUE AND ACCURATE REFLECTION OF OUR REQUIREMENTS AND AGREE THAT THESE PLANS ARE THE PLANS REFERRED TO IN THE MAJOR DOMESTIC BUILDING CONTRACT BETWEEN "BETNALE PTY LTD" (TRADING AS SUPERIOR GRANNY FLATS) AND MYSELF/OURSELVES AND AUTHORISE THEIR USE FOR NEXT STAGE PURPOSES. I/WE AM/ARE FULLY AWARE, IF ANY FURTHER CHANGES ARE TO BE MADE ON THESE PLANS WILL INCUR A VARIATION FEE.**

SIGNED: ..... DATE: .....

SIGNED: ..... DATE: .....

**Callen Bray**  
 Building Design & Drafting  
 Residential - Commercial - Industrial  
 ABN: 38 040 205 161  
 Phone: 0419 441 186  
 Email: Callen\_Bray@hotmail.com  
 Registered Building Practitioner: DP-AD 36967

**Proposed Habitable Outbuilding/ Detached Extension,**  
 At: Lot 137, No. 15 Worcester Cr, Bundoora, VIC 3083  
 For: Betnale Pty. Ltd.

**14.5m x 11m**  
**2 Bedroom**

Sheet No: 1  
 Issue: 01/06/24  
 Rev: 06

**ENERGY EFFICIENCY**

CLASS 1 BUILDINGS IN CLIMATE ZONE 6 ARE REQUIRED TO ACHIEVE A MIN. 6 STAR ENERGY RATING IN ACCORDANCE WITH PART 3.12 OF THE BCA. THIS IS ACHIEVED USING THE (DEEMED TO SATISFY PROVISIONS) OF PART 3.12 OF THE BCA. REFER TO ATTACHED REPORT FOR EXPLANATORY INFORMATION & OVERALL R-VALUES OF ROOF, WALL & FLOOR SYSTEMS

**INSULATION VALUES**

- ROOF: R- 5.0 BATTS (210mm) + REFLECTIVE FOIL INSULATION\*
- WALLS: R- 2.5 WALL BATTS (90mm)
- FLOOR: R- 2.9 REFLECTIVE FOIL INSULATION (4mm)

\* NOTE: REFLECTIVE FOIL INSULATION ASSUMES A SINGLE FOIL SIDED TYPE & POLY WEAVE BACKED WITH AN AVERAGE EMITTANCE VALUE OF 0.05 OUTER & 0.05 INNER. THE REFLECTIVE SIDE MUST FACE DOWNWARD (ROOF) OR INWARD (WALLS) AND BE PLACED DIRECTLY UNDER THE ROOF & WALL CLADDING TO BE EFFECTIVE

**EXTERNAL GLAZING**

- EXTERNAL GLAZING IS SUBJECT TO BUILDING ORIENTATION. REFER TO ATTACHED GLAZING CALCULATION FOR SPECIFIC BUILDING ORIENTATION

**BUILDING SEALING**

- A SEAL TO RESTRICT AIR INFILTRATION MUST BE FITTED TO EACH EDGE OF AN EXTERNAL SLIDING DOOR, WINDOWS AND OPENINGS.
- DRAFT PROTECTORS ARE REQUIRED TO BE FITTED TO THE BOTTOM EDGE OF EXTERNAL SWING DOORS AND SEALS TO THE HEAD AND SIDES.
- SEALS MAY BE FOAM, RUBBER, FIBROUS OR THE LIKE.
- EXHAUST FANS MUST BE FITTED WITH A SELF SEALING DEVICE SUCH AS A SELF-CLOSING DAMPER OR FILTER (RANGEHOOD)
- GAPS AND CRACKS AROUND ROOFS, EXTERNAL FLOORS, WALL/FLOOR/ROOF JUNCTIONS AND AROUND WINDOW AND DOOR FRAMES MUST BE MINIMISED THROUGH GOOD CONSTRUCTION PRACTICE. AND WITH THE PLACING OF CLOSE FITTING INTERNAL LINING AT JUNCTIONS, CAULKING, SKIRTING, ARCHITRAVES AND CORNICES.

**SERVICES**

- SERVICES PIPING AND DUCTWORK MUST COMPLY WITH THE MIN. INSULATION REQUIREMENTS OF PART 3.12.5 OF THE BCA.

**GENERAL NOTES**

- ENERGY EFFICIENCY (WALL, FLOOR, ROOF INSULATION & GLAZING) IN ACCORDANCE WITH PART 3.12 OF THE BCA. REFER TO ENERGY EFFICIENCY NOTES & GLAZING CALCULATIONS FOR DETAILS.
- WET AREAS IN ACCORDANCE WITH PART 3.8.1 OF THE BCA FOR WATERPROOFING & WATER RESISTANCE.
- STEPS: TREAD- 250mm MIN, RISER- 190mm MAX.
- BALUSTRADE :  
 - AT STEPS- 865mm (MIN) HIGH  
 - AT LANDING- 1000mm (MIN) HIGH
- WHERE REQUIRED, HORIZONTAL & VERT. GAPS IN BALUSTRADES MUST BE LESS THAN 125mm IN ACCORDANCE WITH BCA PART 3.9.2
- WRITTEN DIMENSIONS WILL TAKE PRECEDENCE OVER SCALE.
- UNLESS OTHERWISE INDICATED ALL WALL DIMENSIONS ARE:  
 - EXTERNAL 90mm STUD  
 - INTERNAL 90mm STUD
- WC / BATHROOM DOOR TO BE REMOVABLE WHERE REQUIRED AND FITTED WITH LIFT OFF HINGES IN ACCORDANCE WITH BCA PART 3.8.3.3
- ALL GLAZING TO COMPLY WITH PART 3.6 OF THE BCA & AS 1288
- MECHANICAL VENTILATION TO OUTSIDE AIR PROVIDED WHERE REQUIRED AND IN ACCORDANCE WITH B.C.A. P.2.4.5 / 3.8.5
- ROOF TRUSSES (WHERE USED) TO HAVE A MAXIMUM SPACING OF 900mm
- WINDOW GLAZING CODES:  
 - (OBS) OBTUSCURE GLASS  
 - (TLS) TRANSLUCENT GLASS  
 - (DG) DOUBLE GLAZED
- ROOF ACCESS (WHERE APPLICABLE)
- SMOKE DETECTOR (DIRECT WIRED)
- DP - DOWNPIPE (STORMWATER CONNECTED)
- DP - DOWNPIPE (WATER TANK CONNECTED)



**SPECIFICATION**

**FOOTINGS**

\*TYPE 2\* FOOTINGS TO AS 1684.2  
350mm DIA. x 150mm DEEP PRECAST CONCRETE SOLE PLATES

**MIN. SOLE PLATE FOUNDING DEPTHS:**  
IN ACCORDANCE WITH AS 2870

SITE CLASSIFICATION	MIN. DEPTH
A, S, M	500mm
M-D	800mm
H	1000mm

NOTE: SOLE PLATES MUST ALSO BE FOUNDED A MIN. OF 100mm INTO NATURAL SOIL WITH A MIN. BEARING CAPACITY OF 100 kPa. A DEEPER FOUNDING DEPTH MAY BE REQUIRED TO ACHIEVE THIS

**STUMPS**

100x100 MIN. TIMBER STUMPS OF A DURABILITY CLASS 1 OR 2 OR H5 TREATED WITH A MIN. STRESS GRADE OF F4

**BEARERS**

ROOF LOAD WIDTH- MAX. 4655mm  
FLOOR LOAD WIDTH- 1725mm INTERNALLY  
- 1825mm MAX. ON EXT. WALLS

2/140x45 LVL 15 (F17) BEARERS WITH A MAX. CONTINUOUS SPAN OF 2,900mm

**MINIMUM BEARER CLEARANCE TO GROUND LEVEL:**

TERMITE INSPECTION NOT REQUIRED:  
150mm

NOTE: ON SLOPING SITES, 400mm WHEN REQUIRED MAY BE REDUCED TO 150mm WITHIN 2m OF EXTERNAL WALLS

**FLOOR JOISTS**

90x45 MGPIO FLOOR JOISTS AT MAX. 450 CENTRES WITH A MAX. CONTINUOUS SPAN OF 1800mm  
MAX. SINGLE SPAN OF 1500mm OR

90x45 F5 FLOOR JOISTS AT MAX. 450 CENTRES WITH A MAX. CONTINUOUS OF 1600mm

**FLOORING**

19mm THICK "YELLOW TONGUE" PARTICLEBOARD FLOORING.

**TIMBER DURABILITY**

CLASS 1 OR 2 TIMBERS ARE SUITABLE FOR IN GROUND USE. ALTERNATIVELY, H5 TREATED TIMBER CAN BE USED

CLASS 1	CLASS 2
BELIAN CYPRESS (WHITE) IRONBARK TALLOWWOOD TURPENTINE YELLOW CEDAR NORTHERN BOX	BLACKbutt KWL (MERBAU) SPOTTED GUM WESTERN RED CEDAR RIVER RED GUM BALAU TEAK

**WALL FRAMES**

COMMON STUDS: 90x25 F5 AT 600 CTS.  
TOP/BOTTOM FLATES: 45x90 F5  
NOGGINGS: 90x35 AT 1275 CTS.  
JAMB STUDS: 90x25 F5  
OPENING 0 - 900: 2/90x25 F5  
OPENING 900 - 2600: 3/90x25 F5  
OPENING 2600 - 4300:

**LINTELS**

OPENINGS UP TO 1100: 90 x 45 F5  
OPENINGS UP TO 1500: 90 x 45 LVL 15  
OPENINGS UP TO 1800: 140 x 45 F7  
OPENINGS UP TO 2200: 140 x 45 LVL 15  
OPENINGS UP TO 2400: 190 x 45 F7  
OPENINGS UP TO 2600: 190 x 45 MGPI0  
OPENINGS UP TO 3000: 240 x 45 F7

\*ALL STRUCTURAL TIMBER SIZES, FIXINGS & TIE-DOWNS ARE TO BE IN ACCORDANCE WITH AS 1684.2 2010

**WATERPROOFING & WATER RESISTANCE**

ALL WET AREA FLOORS:  
- ENSURE VINYL FLOORING IS DEEMED TO BE WATERPROOF & THAT ALL JOINS ARE SEALED  
- UPTURN VINYL MIN. 25mm AT WALL/FLOOR JUNCTIONS TO CREATE WATERPROOF WATER STOP. SKIRTING BOARDS & ARCHITRAVES PLACED OVER UPTURN & SEALED TO VINYL WITH WATERPROOF ACRYLIC OR SILICONE SEALANT (REFER TO DETAIL)  
- SKIRTING BOARDS & ARCHITRAVES TO WET AREAS TO BE SOLID TIMBER (IE. PINE OR HARDWOOD, NOT MDE)  
SHOWER CUBICLE:  
- 42x42mm ALLUM. WATERSTOP ANGLE OR VINYL FLOORING STRIP WITH MIN. HORIZONTAL DIMENSION OF 40mm EITHER SIDE, SEALED TO WALL AT ALL WALL JUNCTIONS (CORNERS) EXTENDING A MIN. OF 1800mm FROM SHOWER BASE  
- THERMOSET LAMINATE WALL PANELS MIN. OF 1800mm HIGH FROM SHOWER BASE  
ABOVE BASINS, TROUGHES & SINKS (KITCHEN BENCH)

**ELECTRICAL NOTES**

- LIGHT SWITCHES TO BE AT 1000mm ABOVE FLOOR LEVEL.  
- HEIGHTS OF POWER POINTS MEASURED FROM FLOOR LEVEL UNLESS OTHERWISE NOTED.  
- UNLESS DIMENSIONED POWER POINTS TO BE LOCATED TO THE NEAREST STUD.  
- POWER POINTS FOR APPLIANCES & SPLIT SYSTEM AIR-CONDITIONING TO SUIT MANUFACTURERS REQ.  
- PROVIDE PHONE CABLING WITH CONDUIT & DRAW STRING PLUS TV. ANTENNA CABLING THROUGH BARGE END.

**ENERGY EFFICIENCY- LIGHTING**

- ARTIFICIAL LIGHTING MUST NOT EXCEED: CLASS 1 BUILDINGS- 5 W/m<sup>2</sup> VERANDA/PORCH- 4W/m<sup>2</sup> PERIMETER LIGHTING- MIN. 40 LUMENS/W IN ACCORDANCE WITH THE B.C.A PART 3.12  
- INTERNAL LIGHTING MUST NOT EXCEED: 590 WATTS TOTAL  
- PERIMETER LIGHTING COMPLIANT WITH: 8 WATT CFL GLOBE= 50 LUMENS/W  
11 WATT CFL GLOBE= 75 LUMENS/W

**ELECTRICAL LEGEND**

- - CEILING LIGHT OUTLET (240v)
- ▼ - PHONE POINT AT 2000/000
- - LED DOWNLIGHT
- ⊗ - EXHAUST FAN (SELF SEALING)
- ⊕ - INTERNAL SWITCH BOARD
- ⊖ - TV. POINT AT 200
- ⊙ - SMOKE DETECTOR (DIRECT WIRED)
- ⊕ - SMOKE DETECTOR (DIRECT WIRED)
- ⊖ - DOWNPIPE (STORMWATER CONNECTED)
- ⊕ - DOWNPIPE (WATER TANK CONNECTED)

SPP	DPP	HEIGHT	SPP	DPP	HEIGHT
☀	☀	200 F.F.L	☀	☀	1200 F.F.L
☀	☀	350 F.F.L	☀	☀	1275 F.F.L
☀	☀	750 F.F.L	☀	☀	1350 F.F.L
☀	☀	970 F.F.L	☀	☀	1400 F.F.L
☀	☀	1000 F.G.L	☀	☀	2000 F.F.L
☀	☀	1000 F.F.L	☀	☀	IN ROOF

**TERMITE AREAS**

THE PLACEMENT OF A CHEMICAL BARRIER OR SHEET METAL "ANT CAPS" TO THE TOPS OF TIMBER STUMPS IN ACCORDANCE WITH PART 3.1.3 OF THE B.C.A & AS 3660.1 IS SUFFICIENT WHEN PROTECTION AGAINST TERMITE ATTACK IS REQUIRED  
NOTE: A MIN. OF 400mm CLEARANCE IS REQUIRED TO THE UNDERSIDE OF BEARERS ON SITES REQUIRING TERMITE INSPECTION. THIS CAN BE REDUCED TO 150mm ON SLOPING SITES WITHIN 2m OF EXTERNAL WALLS.

**BUSHFIRE AREAS**


DESIGN & SPECIFICATION DOES NOT CONSIDER SITES SUBJECT TO BUSHFIRE ATTACK. SITES DEEMED TO HAVE A BAL OF 12.5 OR MORE HAVE ADDITIONAL CONSTRUCTION REQUIREMENTS IN ACCORDANCE WITH PART 3.7.4 OF THE B.C.A & AS 3959

**INTERNAL ELEVATIONS SPECIFICATION**


WATER PIPE LOCATIONS				FITTING LOCATIONS			
No.	ITEM	ABOVE FFL	No.	ITEM	ABOVE FFL	ITEM	HEIGHT ABOVE FFL
1	TOILET	250	6	SINK	650	PAPER HOLDER	820
2	BIDET	250	7	DW	500	TOWEL RAIL	1000/1600
3	BATH	600	8	TROUGH	1085	TOWEL RING	820
4	SHOWER	1000/1800	9	WM	600/1275	SHOWER SOAP HOLDER	1000 NOMINAL
5	BASIN	600	10	FR WASTE	-		

FRAME OFFSETS: SHOWER ROSE= 430 CL, SHOWER TAPS= 250 CL, SOAP HOLDER= 550 CL


NOTES: - DIMENSIONS TAKEN FROM FRAME - SPLASHBACK TILES: 200x200 - WET AREA SKIRTING BOARDS: SOLID TIMBER 67mm  
- POWERPOINT LOCATION

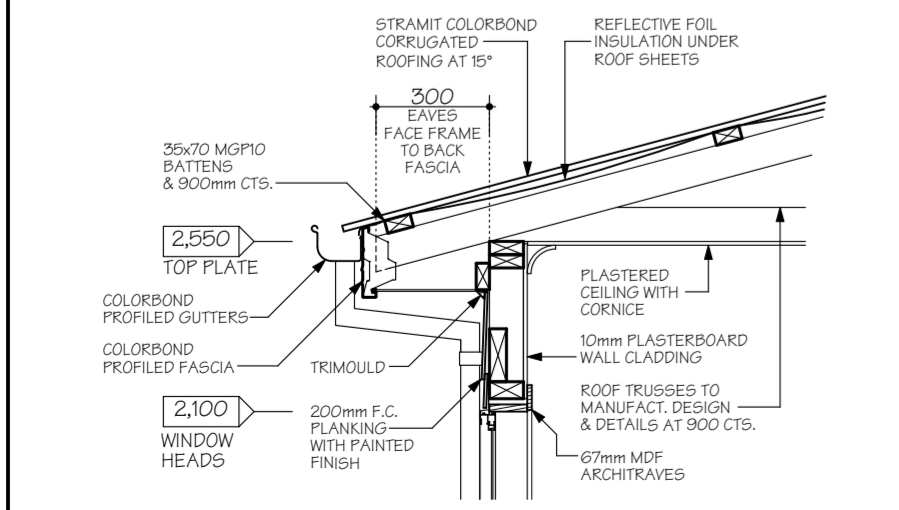


**Typical Eave Wall-Roof Junction**  
Scale 1:20 @ A2

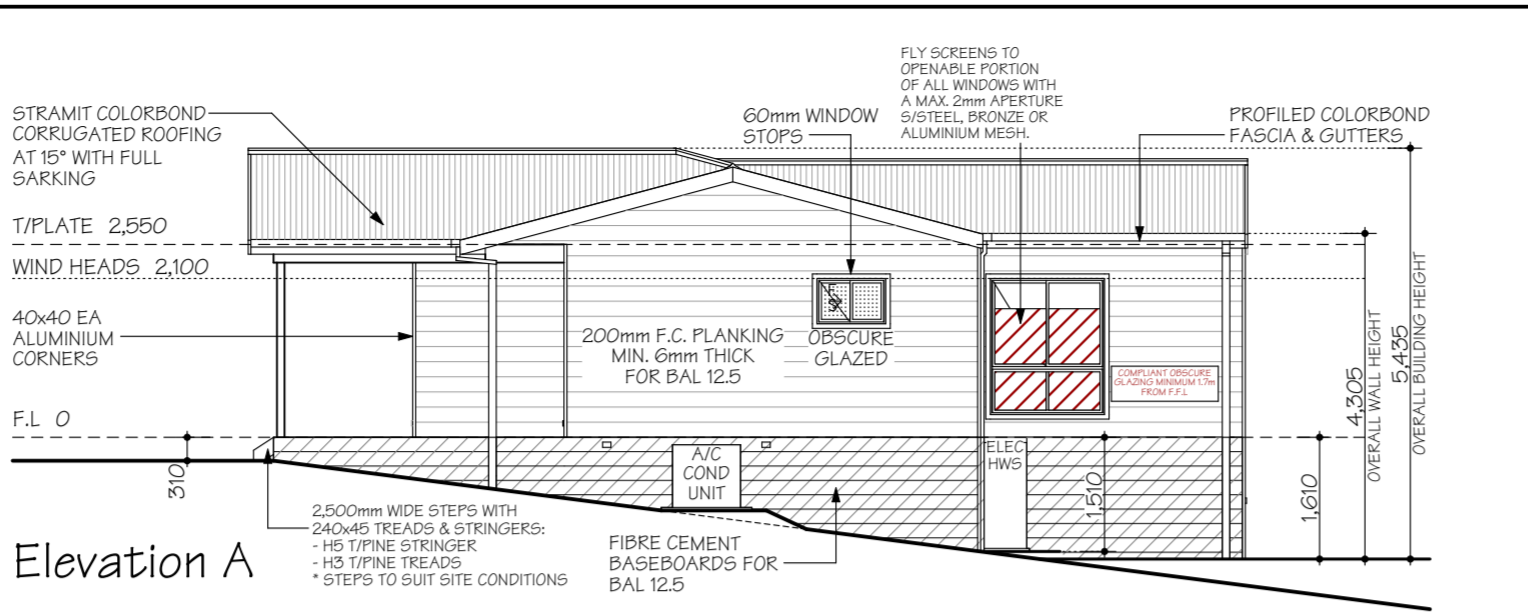


**Elevation A**

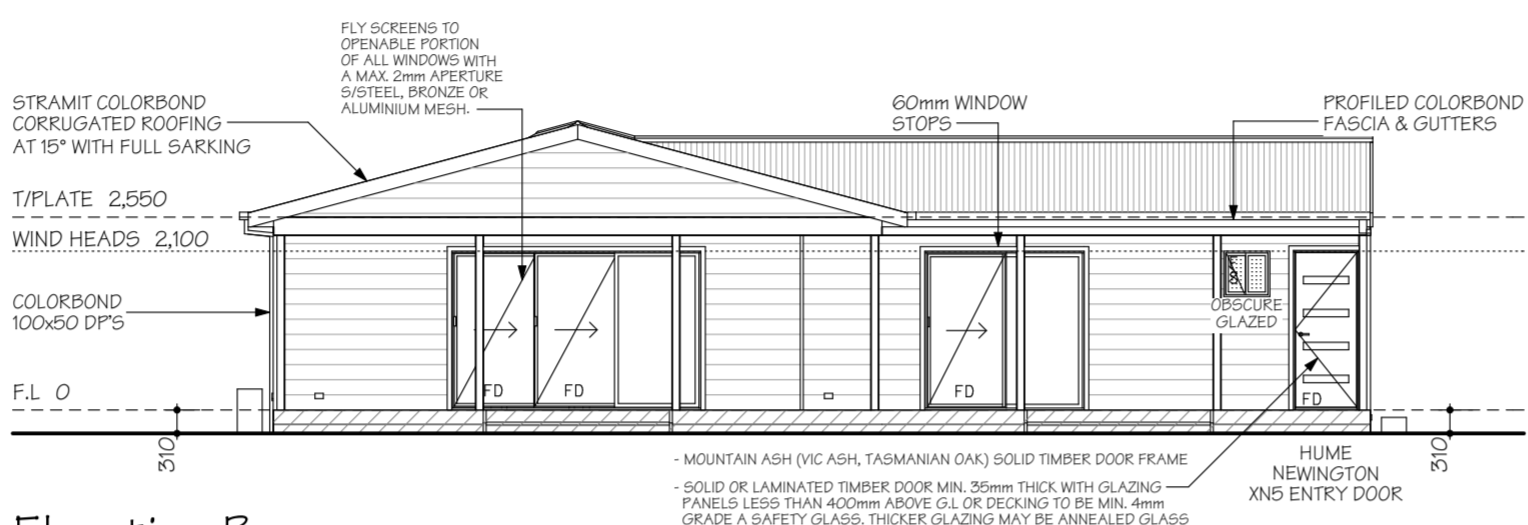


**Elevation B**

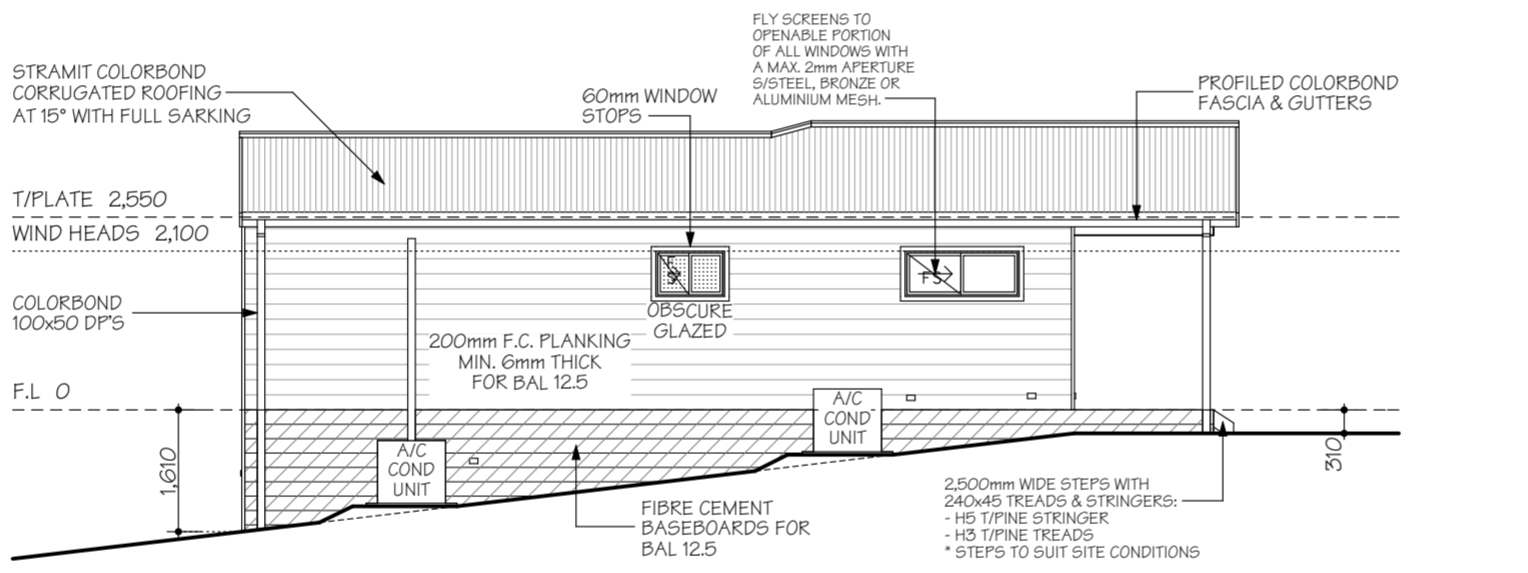

**Elevation C**

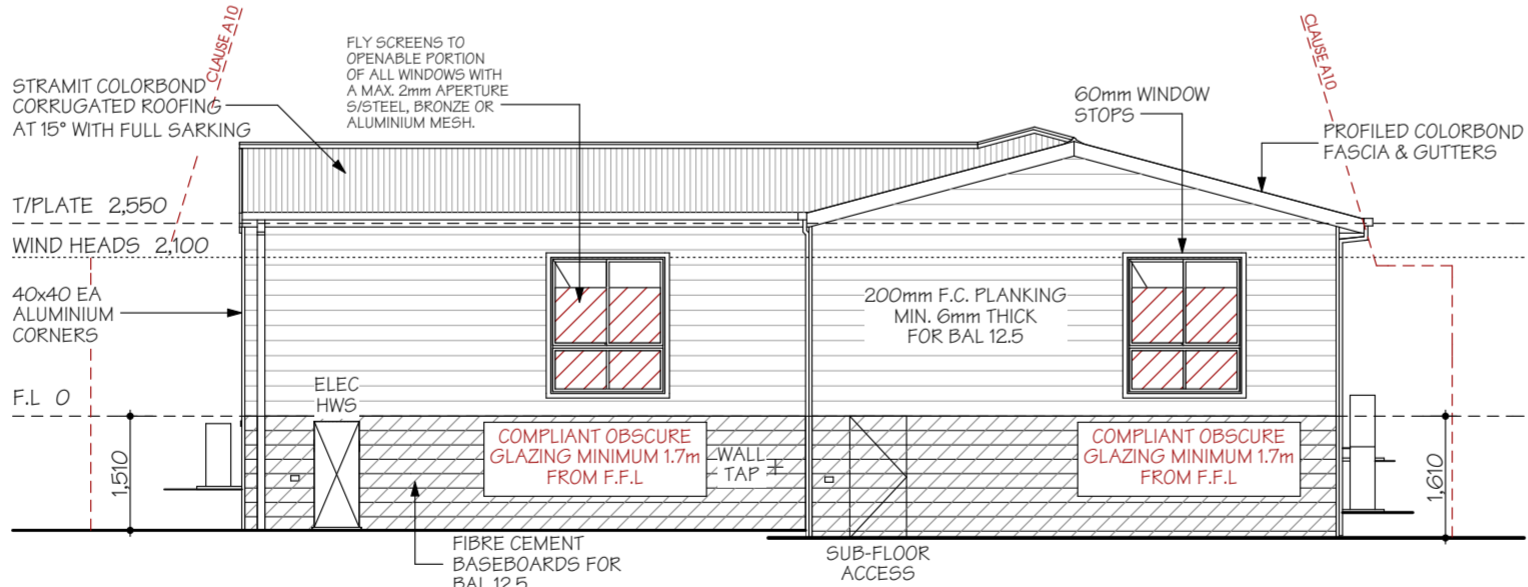

**Elevation D**

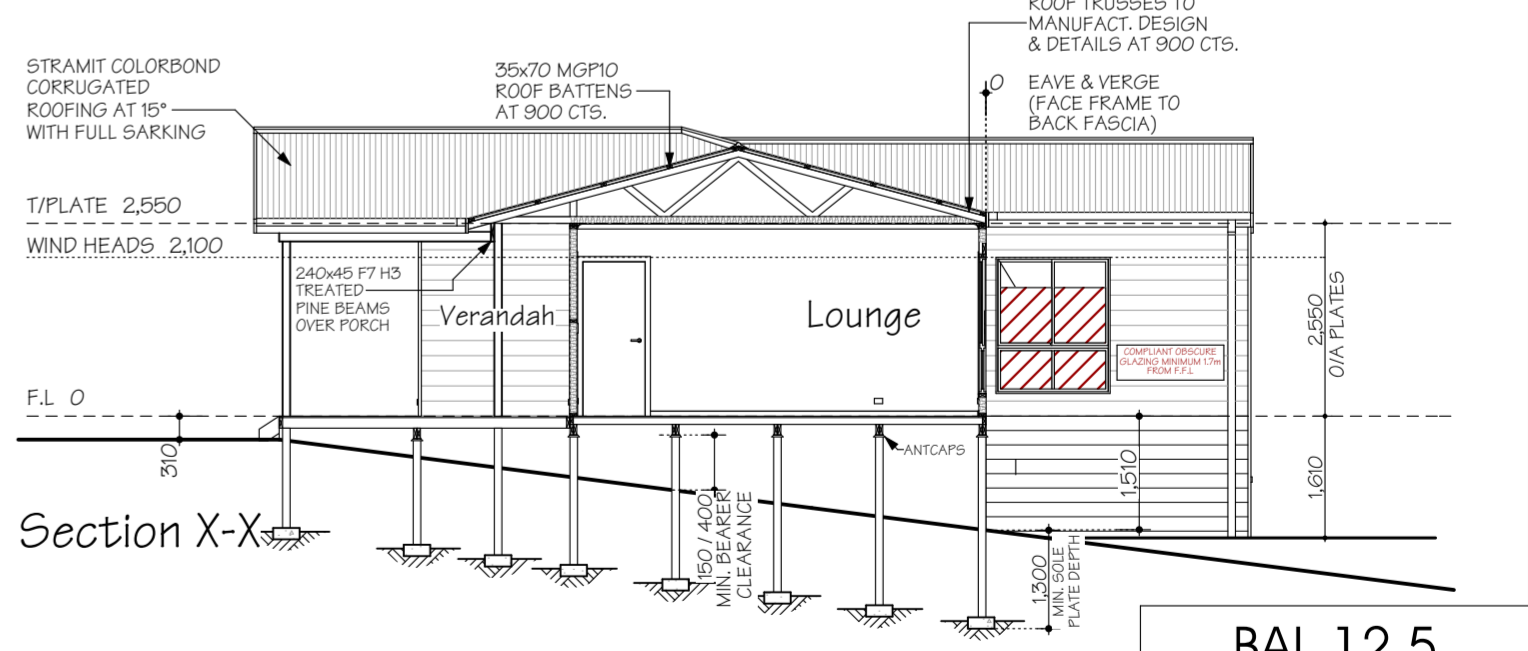

**Section X-X**

**BAL 12.5**  
CONSTRUCTION IN ACCORDANCE WITH AS 3959-2018 FOR A BAL OF 12.5

I/WE .....  
ACKNOWLEDGE THAT THESE PLANS ARE A TRUE AND ACCURATE REFLECTION OF OUR REQUIREMENTS AND AGREE THAT THESE PLANS ARE THE PLANS REFERRED TO IN THE MAJOR DOMESTIC BUILDING CONTRACT BETWEEN "BETNALE PTY LTD" (TRADING AS SUPERIOR GRANNY FLATS) AND MYSELF/OURSELVES AND AUTHORISE THEIR USE FOR NEXT STAGE PURPOSES. I/WE AM/ARE FULLY AWARE, IF ANY FURTHER CHANGES ARE TO BE MADE ON THESE PLANS WILL INCUR A VARIATION FEE.  
SIGNED: ..... DATE: .....  
SIGNED: ..... DATE: .....

**Callen Bray**  
Building Design & Drafting  
Residential - Commercial - Industrial  
ABN: 38 040 205 161  
Phone: 0419 441 186  
Email: Callen\_Bray@hotmail.com  
Registered Building Practitioner: DP-AD 36967

**Proposed Habitable Outbuilding/ Detached Extension,**  
At: Lot 137, No. 15 Worcester Cr, Bundoora, VIC 3083  
For: Betnale Pty. Ltd.

**14.5m x 11m**  
**2 Bedroom**

Sheet No: 3  
Issue: 01/06/24  
Rev: 06

**ENERGY EFFICIENCY**

CLASS 1 BUILDINGS IN CLIMATE ZONE 6 ARE REQUIRED TO ACHIEVE A MIN. 6 STAR ENERGY RATING IN ACCORDANCE WITH PART 3.12 OF THE B.C.A. THIS IS ACHIEVED USING THE (DEEMED TO SATISFY PROVISIONS) OF PART 3.12 OF THE B.C.A. REFER TO ATTACHED REPORT FOR EXPLANATORY INFORMATION & OVERALL R-VALUES OF ROOF, WALL & FLOOR SYSTEMS

**INSULATION VALUES**

- ROOF: R- 5.0 BATTES (210mm) + REFLECTIVE FOIL INSULATION\*
- WALLS: R- 2.5 WALL BATTES (90mm)
- FLOOR: R- 2.9 REFLECTIVE FOIL INSULATION (4mm)

\* NOTE: REFLECTIVE FOIL INSULATION ASSUMES A SINGLE FOIL SIDED TYPE & POLY WEAVE BACKED WITH AN AVERAGE ENTRANCE VALUE OF 0.9 OUTER & 0.09 INNER. THE REFLECTIVE SIDE MUST FACE DOWNWARD (ROOF) OR INWARD (WALLS) AND BE PLACED DIRECTLY UNDER THE ROOF & WALL CLADDING TO BE EFFECTIVE

**EXTERNAL GLAZING**

- EXTERNAL GLAZING IS SUBJECT TO BUILDING ORIENTATION. REFER TO ATTACHED GLAZING CALCULATION FOR SPECIFIC BUILDING ORIENTATION

**BUILDING SEALING**


- A SEAL TO RESTRICT AIR INFILTRATION MUST BE FITTED TO EACH EDGE OF AN EXTERNAL SLIDING DOOR, WINDOWS AND OPENINGS.
- DRAFT PROTECTORS ARE REQUIRED TO BE FITTED TO THE BOTTOM EDGE OF EXTERNAL SWING DOORS AND SEALS TO THE HEAD AND SIDES.
- SEALS MAY BE FOAM, RUBBER, FIBROUS OR THE LIKE.
- EXHAUST FANS MUST BE FITTED WITH A SELF SEALING DEVICE SUCH AS A SELF-CLOSING DAMPER OR FILTER (RANGEHOOD)
- GAPS AND CRACKS AROUND ROOFS, EXTERNAL FLOORS, WALL/FLOOR/ROOF JUNCTIONS AND AROUND WINDOW AND DOOR FRAMES MUST BE MINIMISED THROUGH GOOD CONSTRUCTION PRACTICE. AND WITH THE PLACING OF CLOSE FITTING INTERNAL LINING AT JUNCTIONS, CAULKING, SKIRTING, ARCHITRAVES AND CORNICES.

**SERVICES**

- SERVICES PIPING AND DUCTWORK MUST COMPLY WITH THE MIN. INSULATION REQUIREMENTS OF PART 3.12.5 OF THE B.C.A.


**GENERAL NOTES**

- ENERGY EFFICIENCY (WALL, FLOOR, ROOF INSULATION & GLAZING) IN ACCORDANCE WITH PART 3.12 OF THE B.C.A. REFER TO ENERGY EFFICIENCY NOTES & GLAZING CALCULATIONS FOR DETAILS.
- WET AREAS IN ACCORDANCE WITH PART 3.8.1 OF THE B.C.A FOR WATERPROOFING & WATER RESISTANCE.
- STEPS: TREAD- 250mm MIN, RISER- 190mm MAX.
- BALUSTRADE : - AT STEPS- Ø65mm (MIN) HIGH - AT LANDING- 1000mm (MIN) HIGH
- WHERE REQUIRED, HORIZONTAL & VERT. GAPS IN BALUSTRADES MUST BE LESS THAN 125mm IN ACCORDANCE WITH B.C.A PART 3.9.2
- WRITTEN DIMENSIONS WILL TAKE PRECEDENCE OVER SCALE.
- UNLESS OTHERWISE INDICATED ALL WALL DIMENSIONS ARE: - EXTERNAL 90mm STUD - INTERNAL 90mm STUD
- WC / BATHROOM DOOR TO BE REMOVABLE WHERE REQUIRED AND FITTED WITH LIFT OFF HINGES IN ACCORDANCE WITH B.C.A PART 3.8.3.3
- ALL GLAZING TO COMPLY WITH PART 3.6 OF THE B.C.A & AS 1288
- MECHANICAL VENTILATION TO OUTSIDE AIR PROVIDED WHERE REQUIRED AND IN ACCORDANCE WITH B.C.A. P.2.4.5 / 3.8.5
- ROOF TRUSSES (WHERE USED) TO HAVE A MAXIMUM SPACING OF 900mm
- WINDOW GLAZING CODES: - (OB) OBSURE GLASS - (TL) TRANSLUCENT GLASS - (DG) DOUBLE GLAZED
- ROOF ACCESS (WHERE APPLICABLE)
- SMOKE DETECTOR (DIRECT WIRED)
- DP - DOWNPIPE (STORMWATER CONNECTED)
- DP - DOWNPIPE (WATER TANK CONNECTED)

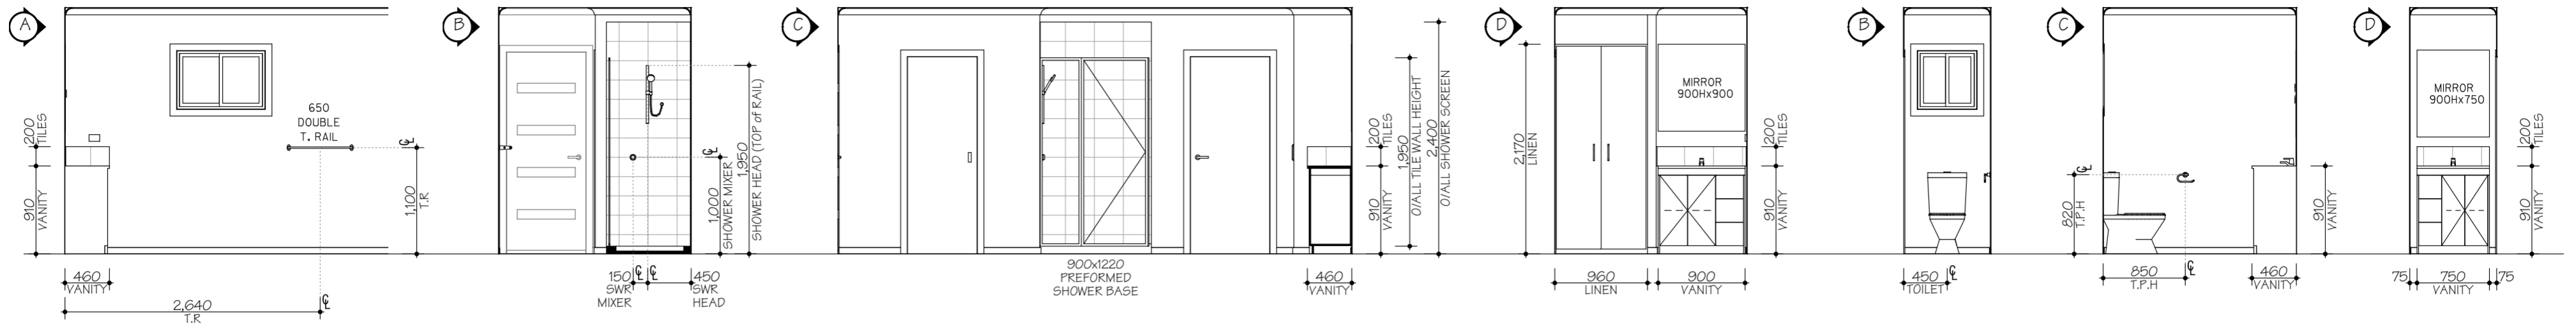


Internal Elevations- Bathroom Scale 1:50

WC

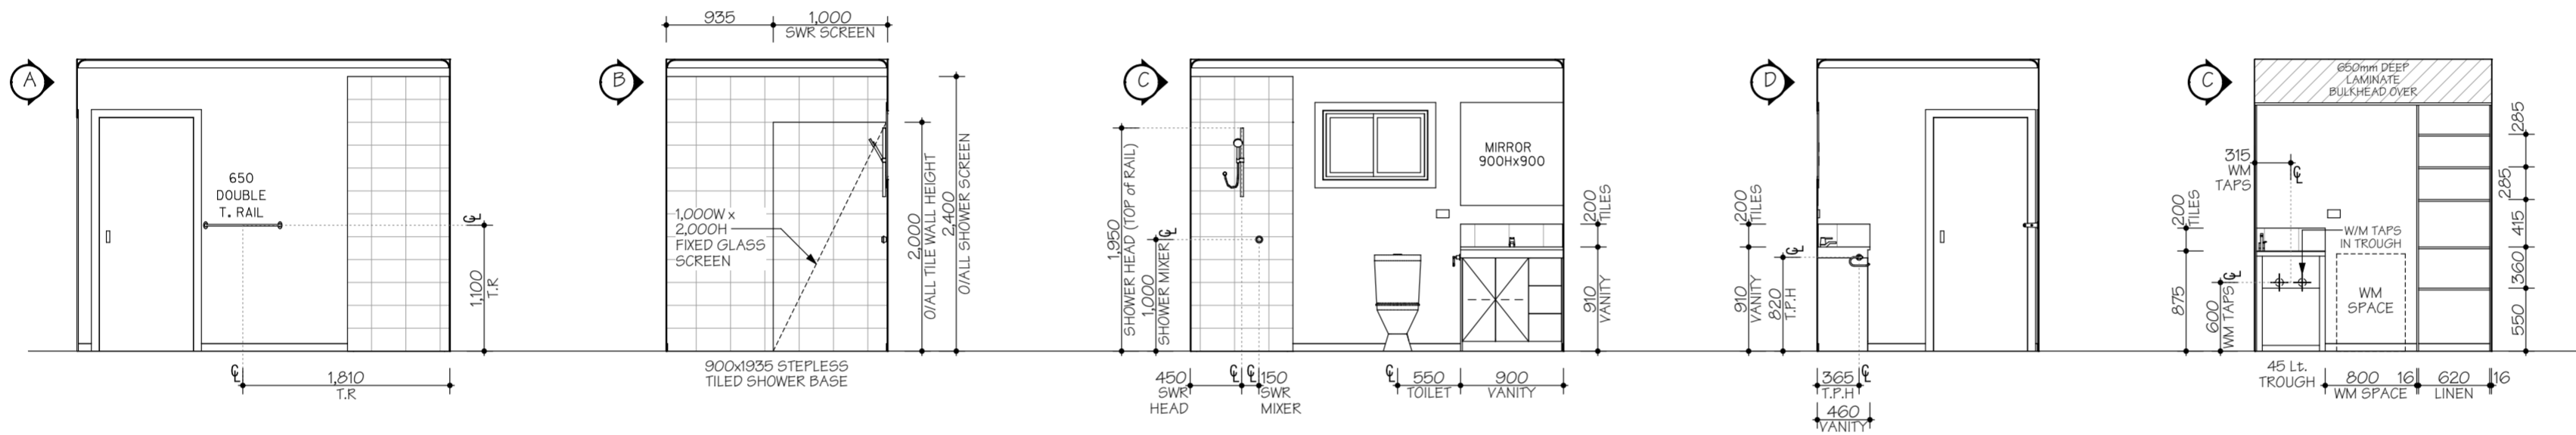

Bathroom

Euro Ldry

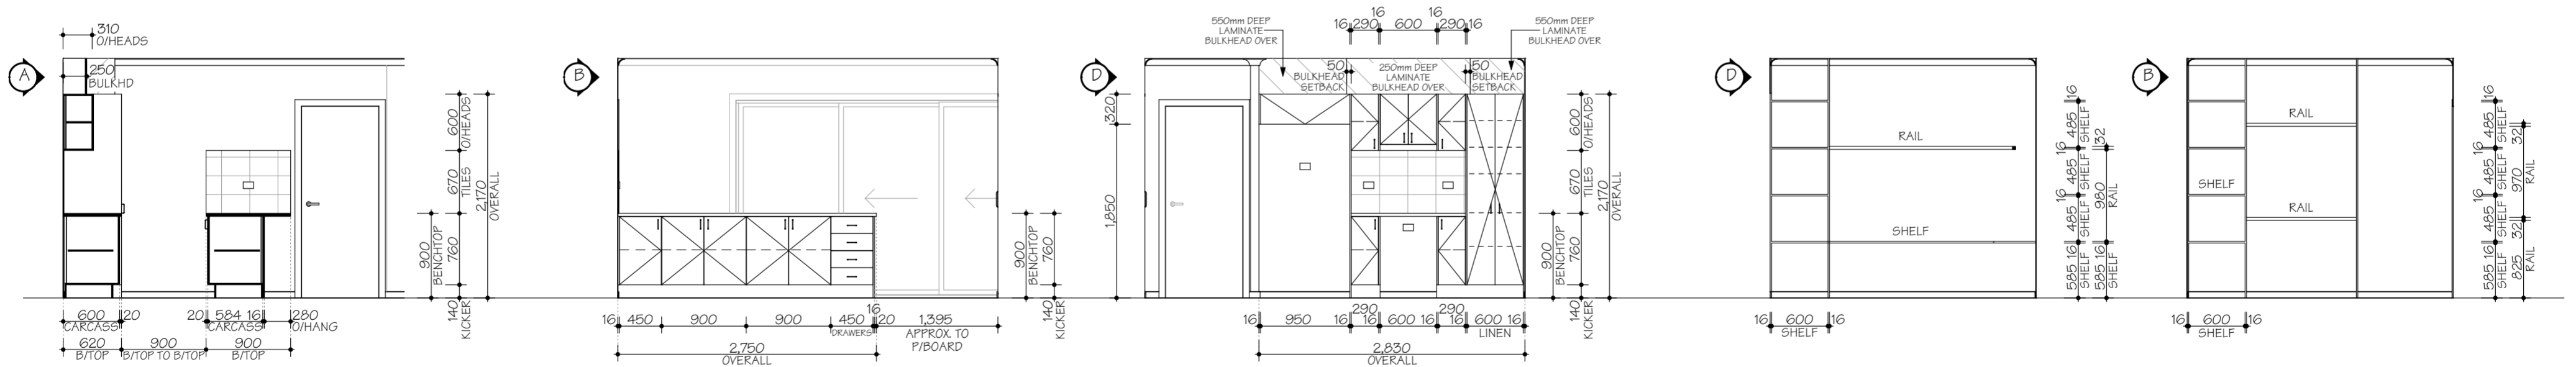

Store

Bed 1 Robe

Bed 2 Robe

**BAL 12.5**  
CONSTRUCTION IN ACCORDANCE WITH  
AS 3959-2018 FOR A BAL OF 12.5


I/WE .....  
ACKNOWLEDGE THAT THESE PLANS ARE A TRUE AND ACCURATE REFLECTION OF OUR REQUIREMENTS AND AGREE THAT THESE PLANS ARE THE PLANS REFERRED TO IN THE MAJOR DOMESTIC BUILDING CONTRACT BETWEEN "BETNALE PTY LTD" (TRADING AS SUPERIOR GRANNY FLATS) AND MYSELF/OURSELVES AND AUTHORISE THEIR USE FOR NEXT STAGE PURPOSES. I/WE AM/ARE FULLY AWARE, IF ANY FURTHER CHANGES ARE TO BE MADE ON THESE PLANS WILL INCUR A VARIATION FEE.  
SIGNED: ..... DATE: .....  
SIGNED: ..... DATE: .....

**Callen Bray**  
Building Design & Drafting  
Residential - Commercial - Industrial  
ABN: 38 040 205 161  
Phone: 0419 441 166  
Email: Callen\_Bray@hotmail.com  
Registered Building Practitioner: DP-AD 36967

Proposed Habitable Outbuilding/  
Detached Extension,  
At: Lot 137, No. 15 Worcester Cr,  
Bundoora, VIC 3083  
For: Betnale Pty. Ltd.

14.5m x 11m  
2 Bedroom


Sheet No: 4  
Issue: 01/06/24  
Rev: 06

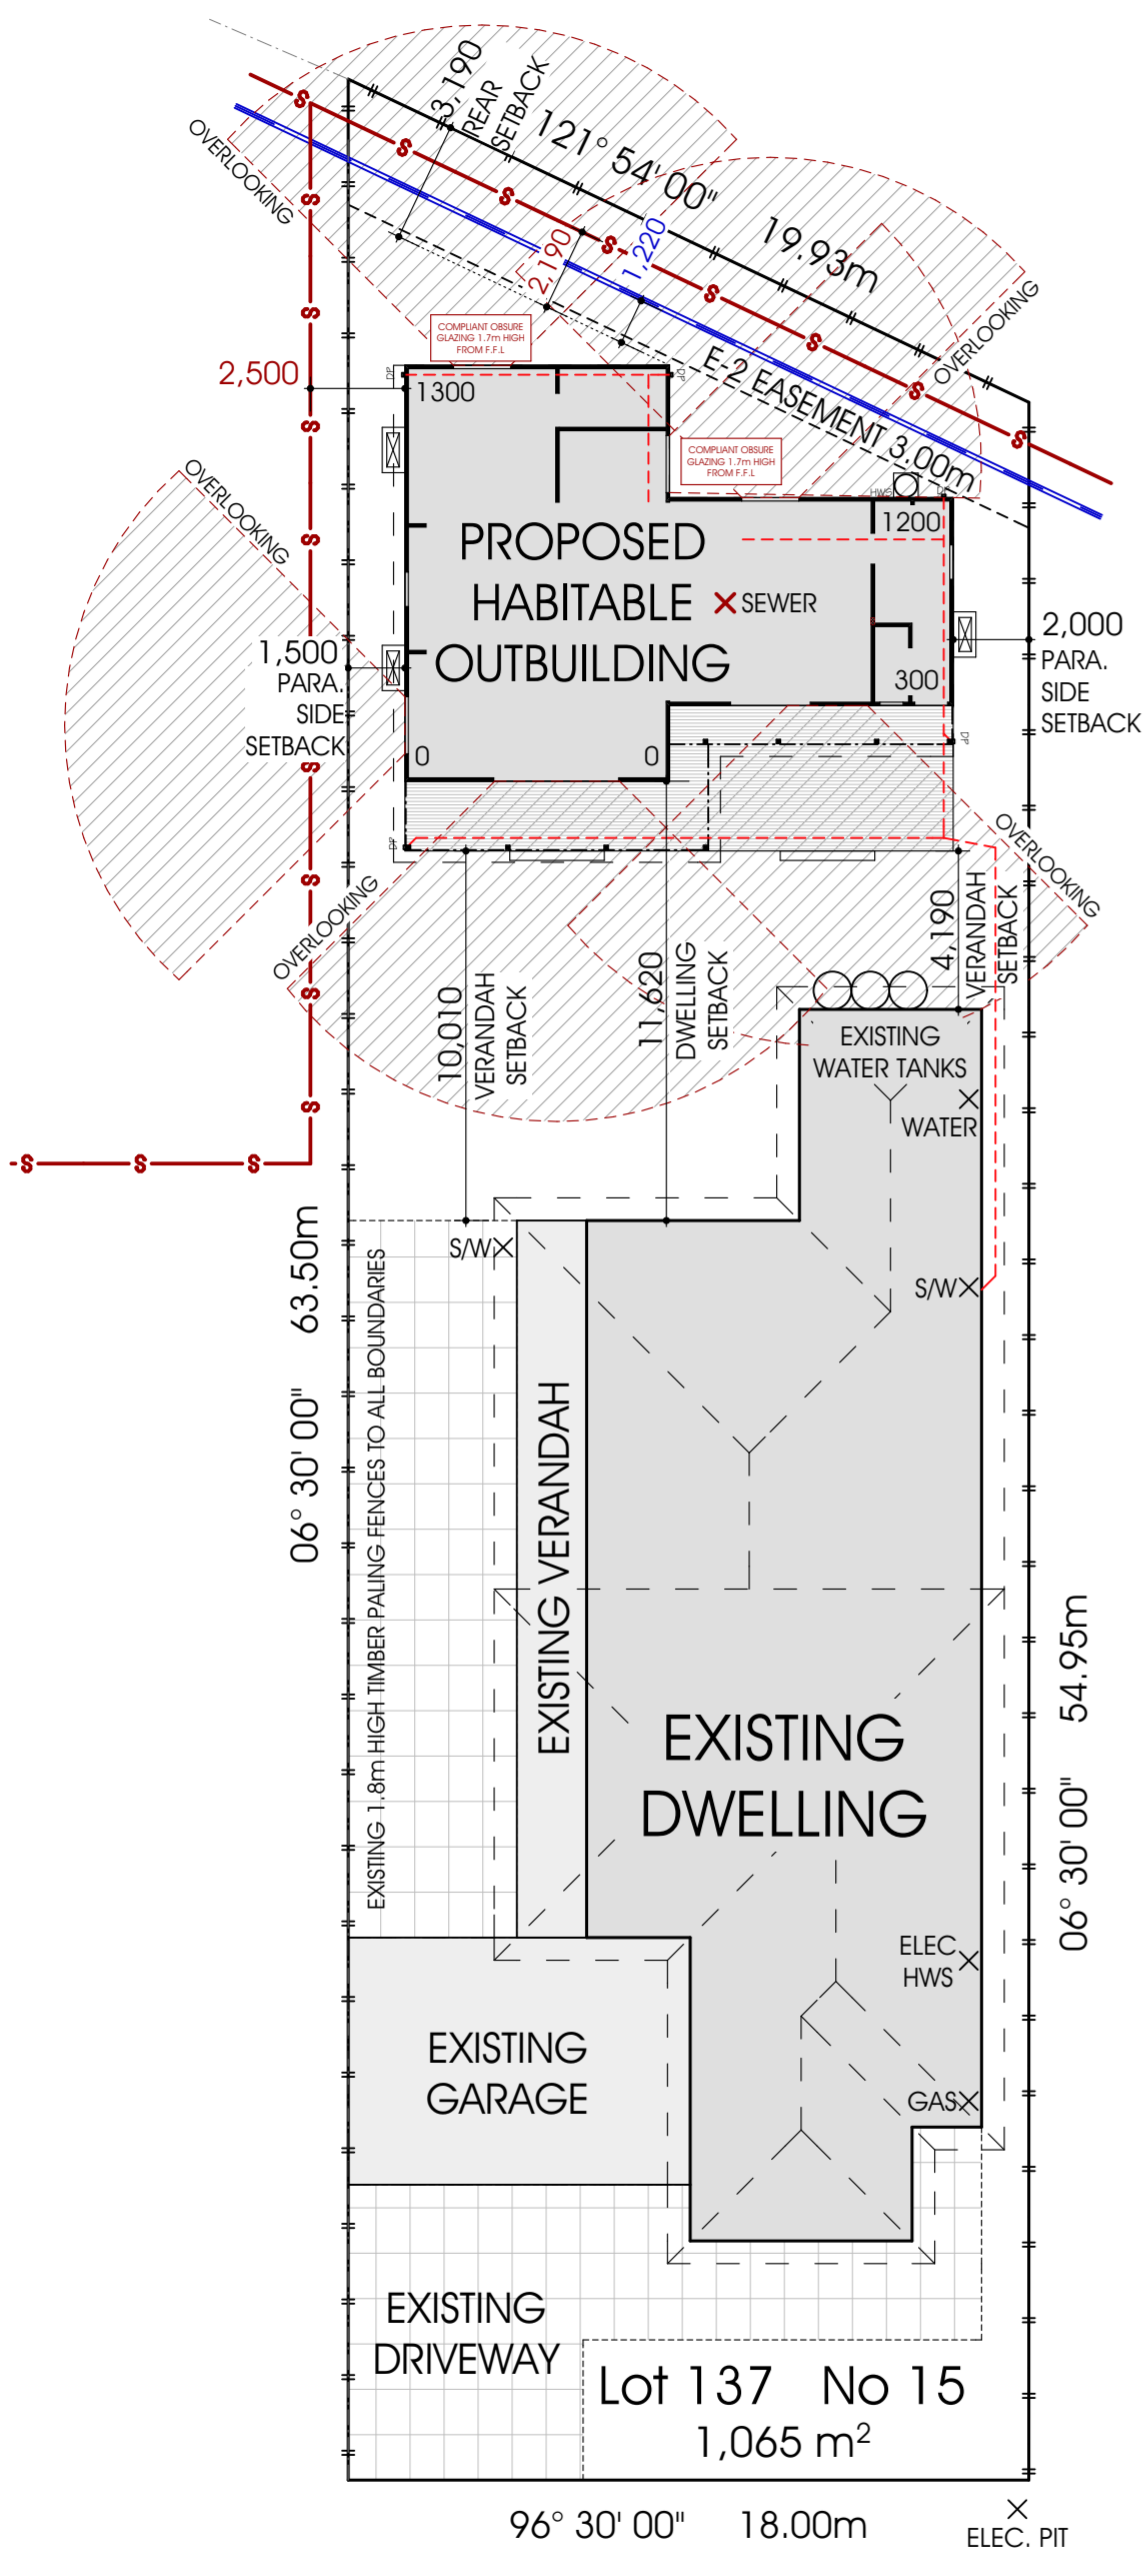

- Stormwater: 90mm PVC underslung beneath unit then underground to connect to existing as required by relevant authority.

- Sewer 150mm diameter  
- 1.586m deep

- S/W 225mm diameter  
- 1.4m deep

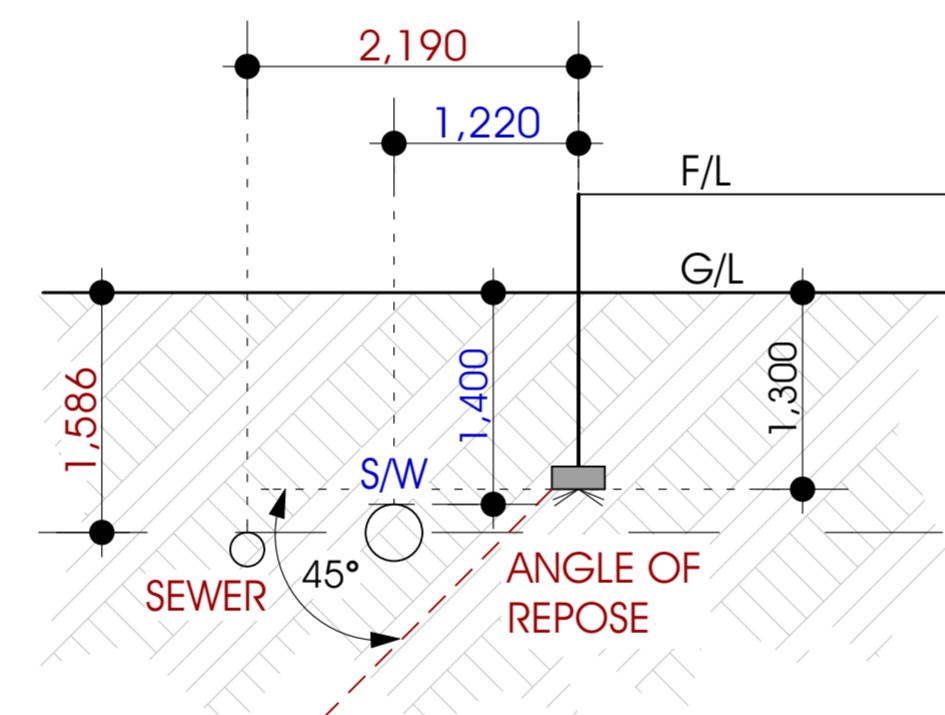

Angle of Repose  
Scale 1:50 @ A2

### Building Fabric R-Values

**Roof Construction**

- Climate Zone 6: Upward Heat Flow
- Unventilated Roof Space
- 0.90 Solar Absorptance (Dark Grey)
- Min R-Value to be achieved R- 5.1

1. Outdoor Air Film (7 m/s)	R- 0.04
2. Metal Roof Cladding	R- 0.00
3. Poly Backed Ref. Foil Ins. (Ref. side down)	R- 0.00
4. Reflective Roof Airspace (as per B.C.A 3.12.1.2)	R- 0.55
5. Ceiling Insulation Batts (210mm)	R- 5.00
6. Plasterboard Ceiling	R- 0.06
7. Inside Air Film (Still Air)	R- 0.11
<b>Total</b>	<b>R- 5.8</b>

**Wall Construction**




- Climate Zone 6
- Min R-Value to be achieved R- 2.8

1. Outdoor Air Film (7 m/s)	R- 0.04
2. F.C. Plank Cladding	R- 0.09
3. Wall Insulation Batts (90mm)	R- 2.50
4. Plasterboard (10mm)	R- 0.06
5. Inside Air Film (Still Air)	R- 0.12
<b>Total</b>	<b>R- 2.8</b>

**Floor Construction**

- Climate Zone 6: Downward Heat Flow
- Enclosed Sub-Floor
- Min R-Value to be achieved R- 2.25

1. "Sancell Breeze" Reflective Foil Insulation (4mm)	R- 0.10
2. Sealed Reflective Airspace (90mm) (As per Sancell Products Specs.)	R- 2.80
<b>Total</b>	<b>R- 2.9</b>

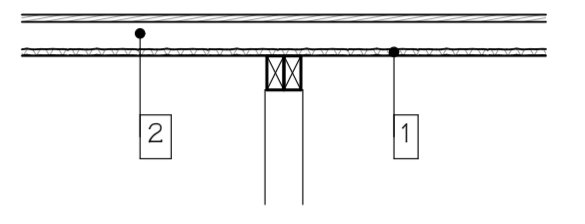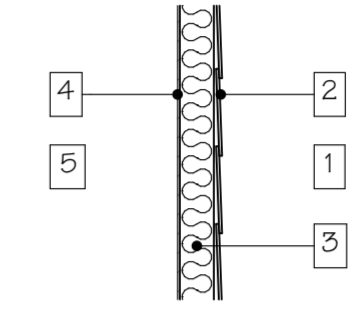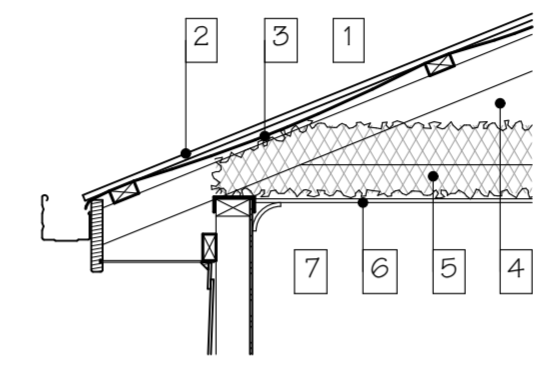


NOTE:  
- TILE ROOF / ON SLAB  
- BACK SECTION OF HOUSE SINGLE STOREY  
- FRONT SECTION OF HOUSE DOUBLE STOREY

**BAL 12.5**  
CONSTRUCTION IN ACCORDANCE WITH AS 3959-2018 FOR A BAL OF 12.5

**SITE COVERAGE DETAILS**


OVERALL SITE AREA:	1,065 m <sup>2</sup>
EXISTING DWELLING:	280 m <sup>2</sup>
EXISTING CLASS 10:	60 m <sup>2</sup>
PROPOSED HABITABLE OUTBUILDING:	118 m <sup>2</sup> (+42%)
PROPOSED HABITABLE OUTBUILDING PORCH:	42 m <sup>2</sup>
OVERALL SITE COVERAGE:	500 m <sup>2</sup> (47%)
TOTAL PERMEABLE AREA:	565 m <sup>2</sup> (53%)

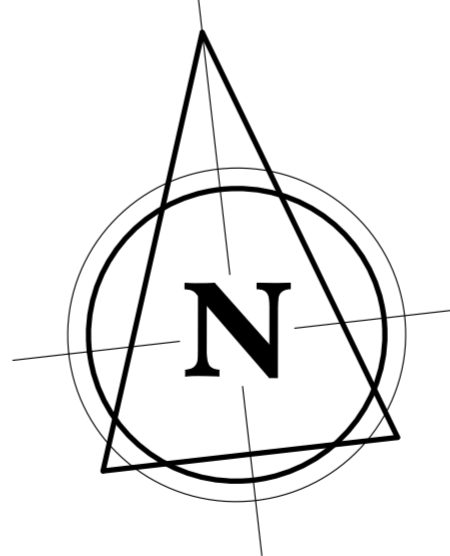

# WORCESTER CRESCENT

Site Plan  
Scale 1:200 @ A2

I/WE .....  
ACKNOWLEDGE THAT THESE PLANS ARE A TRUE AND ACCURATE REFLECTION OF OUR REQUIREMENTS AND AGREE THAT THESE PLANS ARE THE PLANS REFERRED TO IN THE MAJOR DOMESTIC BUILDING CONTRACT BETWEEN "BETNALE PTY LTD" (TRADING AS SUPERIOR GRANNY FLATS) AND MYSELF/OURSELVES AND AUTHORISE THEIR USE FOR NEXT STAGE PURPOSES. I/WE AM/ARE FULLY AWARE, IF ANY FURTHER CHANGES ARE TO BE MADE ON THESE PLANS WILL INCUR A VARIATION FEE.  
SIGNED: ..... DATE: .....  
SIGNED: ..... DATE: .....

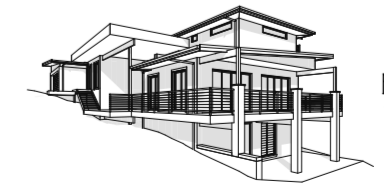

**Callen Bray**  
Building Design & Drafting  
Residential - Commercial - Industrial  
ABN: 38 040 205 161  
Phone: 0419 441 186  
Email: Callen\_Bray@hotmail.com  
Registered Building Practitioner: DP-AD 36967

Proposed Habitable Outbuilding/  
Detached Extension,  
At: Lot 137, No. 15 Worcester Cr,  
Bundoora, VIC 3083  
For: Betnale Pty. Ltd.  
14.5m x 11m  
2 Bedroom  
Sheet No: 5  
Issue: 01/06/24  
Rev: 06

# BUSHFIRE PRONE AREA - BAL:12.5

## CONSTRUCTION AS PER AS 3959-2018 FOR BAL LEVEL 12.5

### SUBFLOOR SUPPORTS:

- NO CONSTRUCTION REQUIREMENTS WHEN SUBFLOOR ENCLOSED WITH MIN. 6mm F.C WALL CLADDING
- WHERE THE SUBFLOOR SPACE IS UNENCLOSED, THE SUPPORT POSTS, COLUMNS, STUMPS, PIERS AND POLES SHALL BE:
  - (i) OF NON-COMBUSTIBLE MATERIAL; OR
  - (ii) OF BUSHFIRE RESISTANT TIMBER; OR
  - (iii) A COMBINATION OF ITEMS (i) AND (ii) ABOVE.

### FLOORS:

- NO CONSTRUCTION REQUIREMENTS WHEN SUBFLOOR ENCLOSED WITH MIN. 6mm F.C WALL CLADDING
- WHERE THE SUB-FLOOR SPACE IS UNENCLOSED, THE BEARERS, JOISTS AND FLOORING, LESS THAN 400mm ABOVE FINISHED GROUND LEVEL, SHALL BE ONE OF THE FOLLOWING: MATERIALS THAT COMPLY WITH THE FOLLOWING:
  - BEARERS AND JOISTS SHALL BE:
    - (i) NON-COMBUSTIBLE; OR
    - (ii) BUSHFIRE-RESISTANT TIMBER; OR
    - (iii) A COMBINATION OF ITEMS (i) AND (ii) ABOVE.

### FLOORING SHALL BE:

- FLOORING SHALL BE:
  - (i) NON-COMBUSTIBLE; OR
  - (ii) BUSHFIRE-RESISTANT TIMBER; OR
  - (iii) TIMBER (OTHER THAN BUSHFIRE-RESISTANT TIMBER), PARTICLEBOARD OR PLYWOOD FLOORING WHERE THE UNDERSIDE IS LINED WITH SARKING-TYPE MATERIAL OR WOOL INSULATION; OR
  - (iv) A COMBINATION OF ANY OF ITEMS (i), (ii) OR (iii) ABOVE; OR
  - (v) A SYSTEM COMPLYING WITH AS 1550.5.1

THIS STANDARD DOES NOT PROVIDE CONSTRUCTION REQUIREMENTS FOR ELEMENTS OF ELEVATED FLOORS, INCLUDING BEARERS, JOISTS AND FLOORING, IF THE UNDERSIDE OF THE ELEMENT IS 400mm OR MORE ABOVE FINISHED GROUND LEVEL.

### EXTERNAL WALLS:

- MIN. 6mm F.C WALL CLADDING. ALL JOINTS TO BE COVERED, SEALED, OVERLAPPED, BACKED OR BUTT-JOINED TO PREVENT GAPS GREATER THAN 3mm

### VENTS:

- EXTERNAL VENTS FITTED WITH EMBER GUARDS OF MAX. 2mm APERTURE STAINLESS STEEL, BRONZE OR ALUMINIUM MESH.

### WINDOWS & GLAZING:

- PLY SCREENS OR SECURITY SCREEN WHEN FITTED TO HAVE MAX. 2mm APERTURE 5/STEEL, BRONZE OR ALUMINIUM MESH.
- FLY SCREEN OR SECURITY SCREEN FRAME WHEN FITTED TO BE EITHER METAL OR BUSHFIRE RESISTANT TIMBER OR A TIMBER SPECIES SPECIFIED IN PARAGAPH E2, APPENDIX E.
- WINDOWS TO BE COMPLETELY PROTECTED BY A BUSHFIRE SHUTTER THAT COMPLIES WITH AS 3959 CLAUSE 5.5.1 OR
- WINDOWS TO BE COMPLETELY PROTECTED BY EXTERNAL SCREENS WITH MAX. 2mm APERTURE 5/STEEL, BRONZE OR ALUMINIUM MESH WITH METAL OR BUSHFIRE RESISTANT TIMBER FRAME OR A TIMBER SPECIES SPECIFIED IN PARAGAPH E2, APPENDIX E. OR
- WINDOW FRAMES & JOINERY TO BE METAL OR BUSHFIRE RESISTANT TIMBER OR A TIMBER SPECIES SPECIFIED IN PARAGAPH E2, APPENDIX E. AND
  - EXTERNALLY FITTED HARDWARE TO BE METAL. AND
  - GLAZING LESS THAN 400mm ABOVE THE GROUND OR DECK TO BE MIN. 4mm GRADE A SAFETY GLASS OR THICKER GLAZING MAY BE ANNEALED (EXTERNAL LEAF IN DOUBLE GLAZING ONLY) AND
  - OPENABLE PORTIONS OF ALL WINDOWS TO BE SCREENED INTERNALLY OR EXTERNALLY WITH MAX. 2mm APERTURE 5/STEEL, BRONZE OR ALUMINIUM MESH WITH METAL OR BUSHFIRE RESISTANT TIMBER FRAME OR A TIMBER SPECIES SPECIFIED IN PARAGAPH E2, APPENDIX E.

### EXTERNAL DOORS:

- SIDE HUNG EXTERNAL DOORS AND DOOR FRAMES TO BE COMPLETELY PROTECTED BY A BUSHFIRE SHUTTER THAT COMPLIES WITH AS 3959 CLAUSE 5.5.1. OR
- BE PROTECTED EXTERNALLY BY SCREENS WITH MAX. 2mm APERTURE 5/STEEL, BRONZE OR ALUMINIUM MESH WITH METAL OR BUSHFIRE RESISTANT TIMBER FRAME OR A TIMBER SPECIES SPECIFIED IN PARAGAPH E2, APPENDIX E. OR

### ALTERNATIVELY DOORS AND DOOR FRAMES COMPLY WITH THE FOLLOWING:

#### DOORS SHALL BE:

- NON-COMBUSTIBLE OR
- A SOLID TIMBER, LAMINATED TIMBER OR RECONSTITUTED TIMBER HAVING A MINIMUM THICKNESS OF 35mm FOR THE FIRST 400mm ABOVE THE THRESHOLD. OR
- A HOLLOW CORE DOOR WITH A NON-COMBUSTIBLE KICKPLATE ON THE OUTSIDE FOR THE FIRST 400mm ABOVE THE THRESHOLD OR
- BE PROTECTED EXTERNALLY BY SCREENS WITH MAX. 2mm APERTURE 5/STEEL, BRONZE OR ALUMINIUM MESH WITH METAL OR BUSHFIRE RESISTANT TIMBER FRAME OR A TIMBER SPECIES SPECIFIED IN PARAGAPH E2, APPENDIX E. AND
- GLAZING PANELS LESS THAN 400mm ABOVE THE GROUND OR DECK TO BE MIN. 4mm GRADE A SAFETY GLASS OR THICKER GLAZING MAY BE ANNEALED AND
- DOOR FRAMES LESS THAN 400mm ABOVE THE GROUND OR DECK TO BE METAL OR BUSHFIRE RESISTANT TIMBER OR A TIMBER SPECIES SPECIFIED IN PARAGAPH E2, APPENDIX E. AND
- WEATHER STRIPS, DRAUGHT EXCLUDERS OR DRAUGHT SEALS SHALL BE INSTALLED AT THE BASE OF SIDE HUNG DOORS.

#### ROOF:

- NON-COMBUSTIBLE ROOFING (METAL) TO BE USED
- ROOF/WALL JUNCTIONS TO BE SEALED TO PREVENT GAPS GREATER THAN 3mm
- ROOF/GABLE/EAVES VENTS TO BE FITTED WITH EMBER GUARDS OF MAX. 2mm APERTURE 5/STEEL, BRONZE OR ALUMINIUM MESH
- METAL ROOFS TO BE:
  - FULLY SARKED AND
  - HAVE GAPS GREATER THAN 3mm (UNDER CORRUGATIONS & RIBS) SEALED AT THE FASCIA OR WALL LINE WITH MAX. 2mm APERTURE STAINLESS STEEL/ BRONZE/ALUMINIUM MESH OR MINERAL WOOL INSULATION.

#### EAVES, FASCIAS & GABLES:

- EAVES, BARGES & GABLE CLADDING TO BE:
  - NON-COMBUSTIBLE OR
  - MIN. 6mm FIBRE CEMENT OR
  - BUSHFIRE RESISTANT TIMBER OR A TIMBER SPECIES SPECIFIED IN PARAGAPH E2, APPENDIX E

- JOINS IN EAVES LININGS, FASCIAS AND GABLES MAY BE SEALED WITH PLASTIC JOINING STRIPS OR TIMBER STORM MOULDS
- JUNCTIONS TO BE SEALED TO PREVENT GAPS GREATER THAN 3mm OR SEALED WITH MAX. 2mm APERTURE 5/STEEL, BRONZE OR ALUMINIUM MESH

#### GUTTERS & DOWNPIPES:

- IF INSTALLED, GUTTER GUARDS SHALL BE NON-COMBUSTIBLE

#### DECKS, STEPS & LANDINGS:

- MATERIALS USED TO ENCLOSE THE SUB-FLOOR THAT ARE LESS THAN 400mm ABOVE THE GROUND MUST BE:
  - NON-COMBUSTIBLE OR
  - MIN. 6mm FIBRE CEMENT OR
  - BUSHFIRE RESISTANT TIMBER OR A TIMBER SPECIES SPECIFIED IN PARAGAPH E1, APPENDIX E

- DECKING AND STAIR TREADS THAT ARE LESS THAN 400mm BELOW GLAZING ELEMENTS BE NON-COMBUSTIBLE OR BUSHFIRE RESISTANT TIMBER OR A TIMBER SPECIES SPECIFIED IN PARAGAPH E1, APPENDIX E

#### BALUSTRADES & HANDRAILS:

- NONE

#### WATER & GAS SUPPLY PIPES:

- WHEN EXPOSED AND ABOVE GROUND MUST BE METAL

#### BUSHFIRE RESISTANT TIMBER:

- SILVERTOP ASH
- BLACKBUTT
- RIVER RED GUM
- SPOTTED GUM
- RED IRONBARK
- MERBAU (KWILA)
- TURPENTINE

#### ABOVE GROUND EXPOSED TIMBER MUST ALSO BE DURABILITY CLASS 1 OR 2:

- PARAGAPH E1, APPENDIX E COMPATIBLE SPECIES (GENERAL CONSTRUCTION):

- BELIAN
- BLACKBUTT
- MERBAU (KWILA)
- IRONBARK (RED & GREY)
- TALLOWOOD
- MERBAU (KWILA)
- TURPENTINE
- RIVER RED GUM
- BALAU
- NORTHERN BOX

- PARAGAPH E2, APPENDIX E COMPATIBLE SPECIES (WINDOWS & DOORS):

- BELIAN
- BLACKBUTT
- CYPRESS
- MERBAU (KWILA)
- IRONBARK (RED & GREY)
- SPOTTED GUM
- TALLOWOOD
- TURPENTINE
- RIVER RED GUM
- BALAU
- NORTHERN BOX

- BUSHFIRE RESISTANT TIMBER SPECIES:

- BLACKBUTT
- MERBAU (KWILA)
- RIVER RED GUM
- SPOTTED GUM
- TURPENTINE


- ABOVE GROUND PROTECTED OR EXPOSED & PAINTED

- PARAGAPH E2, APPENDIX E COMPATIBLE SPECIES (WINDOWS & DOORS):


- MOUNTAIN ASH (VIC ASH, TASMANIAN OAK)

**BAL 12.5**


CONSTRUCTION IN ACCORDANCE WITH  
AS 3959-2018 FOR A BAL OF 12.5

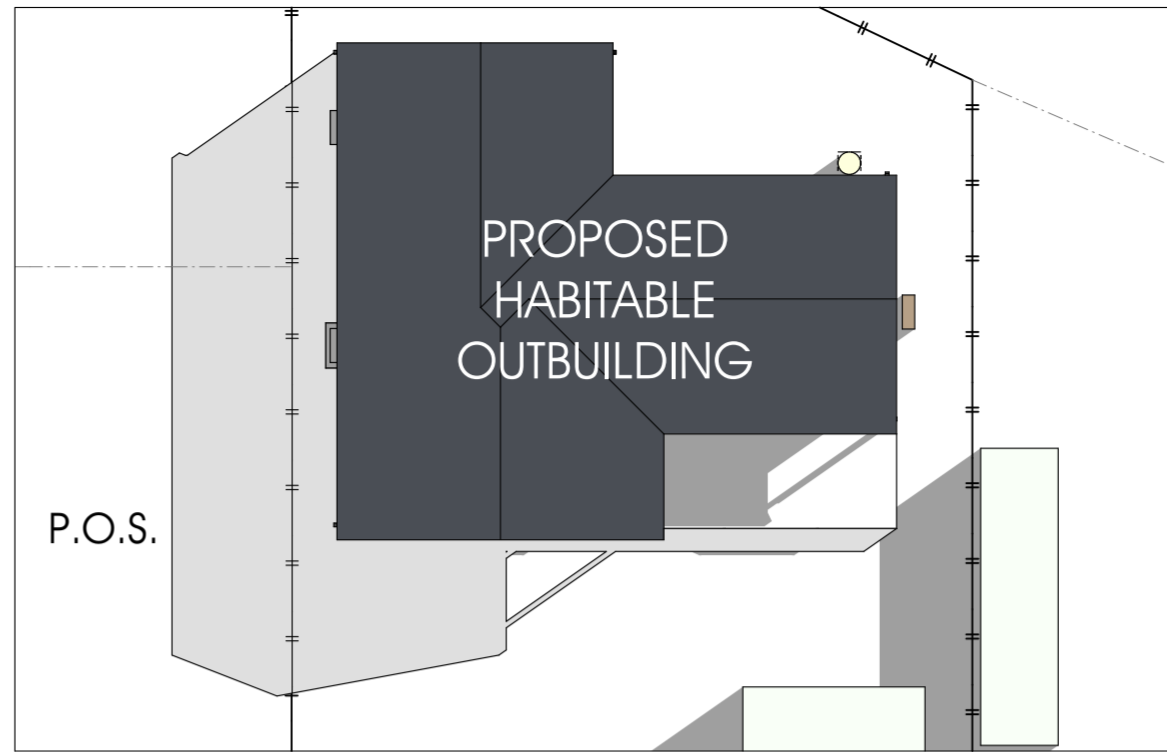

September 22nd - 9am

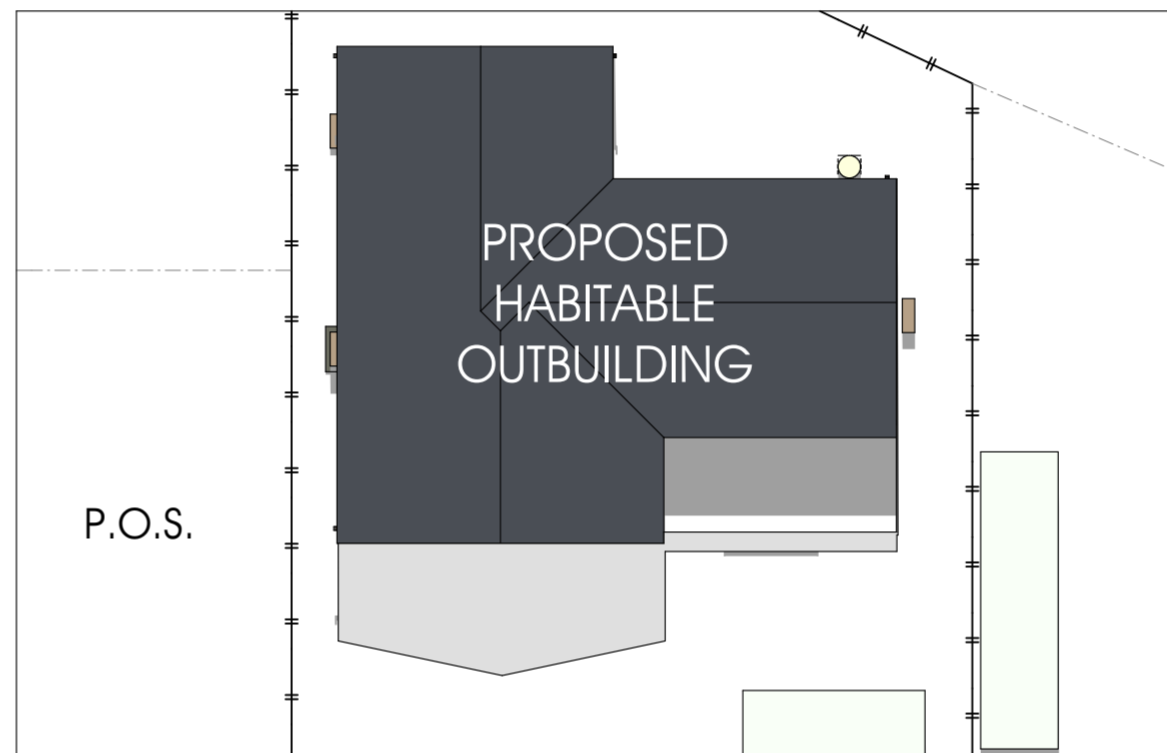

September 22nd - 12pm

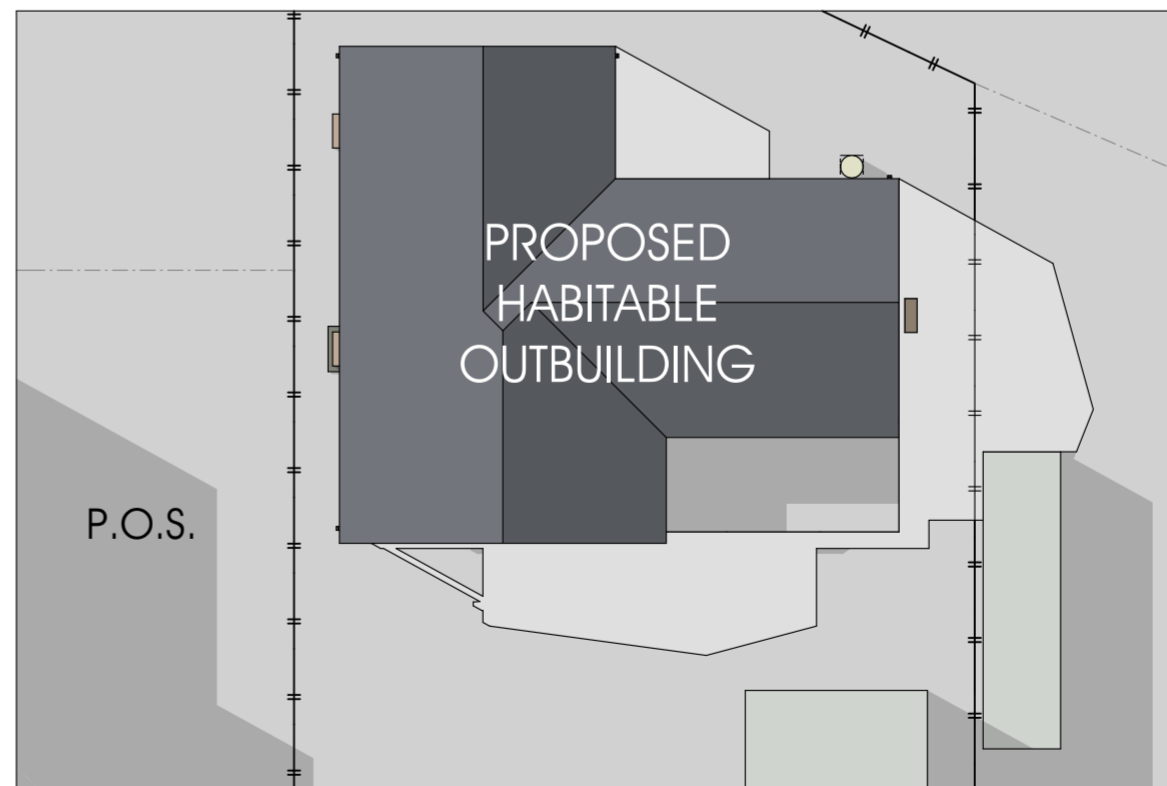


September 22nd - 3pm

## Shadow Diagrams

Scale 1:100 @ A2

- Existing Shadow
- Proposed Shadow

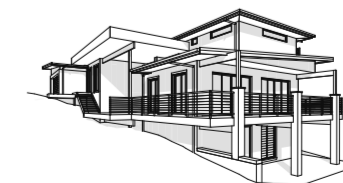

**Callen Bray**

Building Design & Drafting  
Residential - Commercial - Industrial  
ABN: 38 040 205 161  
Phone: 0419 441 166  
Email: Callen\_Bray@hotmail.com  
Registered Building Practitioner: DP-AD 36967

Proposed Habitable Outbuilding/  
Detached Extension,  
At: Lot 137, No. 15 Worcester Cr,  
Bundoora, VIC 3083  
For: Betnale Pty. Ltd.

14.5m x 11m  
2 Bedroom

Sheet No: 6  
Issue: 01/06/24  
Rev: 06